

SECTION 5

Scope of Work and Technical Specifications

Bidding Document for Construction of Smart Roads Ph-II (10 KM) and Beautification of 12 Nos. Junctions in Shillong under the Smart Cities Mission

Tender No.:

Office of the Chief Engineer (NH), PWD(Roads)
Lower Lachumiere, Shillong-793001, Meghalaya.

Contents

List of Tables	5
1 Scope of Work.....	6
1.1 General	6
1.2 Location of the roads and Junctions to be developed in Shillong	6
1.3 Detailed Scope of Work	9
1.4 Utility shifting and provision of temporary service connections during construction - to be done by concerned Departments/ Agencies.....	14
TECHNICAL SPECIFICATIONS FOR “CIVIL WORKS”	15
2 General.....	16
2.1 Technical Specifications and Work Requirements and order of applicability of various Specifications/ Codes/ Standards/ Guidelines for civil works.....	16
2.2 Specifications of items/ works for road works.....	16
2.3 Specifications of items/ works for other civil works	20
2.4 Technical Specifications of specific items/ works (non-scheduled).....	20
2.5 Street-scaping works	21
2.6 Planting and Landscaping	24
TECHNICAL SPECIFICATIONS FOR “ELECTRICAL WORKS”	28
3 General.....	29
3.1 Applicable Codes/ Standards/ Guidelines	29
3.2 General Requirements to be complied with by the Bidders	30
4 Compact Sub-station (Prefabricated Packaged Sub-station)	31
4.1 Design Criteria	31
4.2 Service Conditions.....	31
4.3 Specific Requirement.....	32
4.4 Rating.....	32
4.5 Specifications of Compact Sub-stations and their tentative locations	33
4.6 Technical Specifications of Transformers.....	37
4.7 SCADA.....	41
4.8 Guaranteed Technical Particulars (GTP) of CSS/PSS.....	43
5 RING MAIN UNIT	44
5.1 General Specifications	44
5.2 Applicable Codes and Standards	44
5.3 Ring Main Unit Specification.....	45
5.4 Minimum requirements of Ring Main Units.....	48
5.5 Technical Particulars for Ring Main Unit & its Components	49
5.6 Guaranteed Technical Particulars (GTP) of RMU	53

6	FIELD REMOTE TERMINAL UNIT [For PSS (11 kV / 415 V) & RMU].....	53
6.1	TECHNICAL REQUIREMENTS OF FRTU.....	53
6.2	Design Standards	53
6.3	FRTU Functions.....	53
6.4	Salient Features	55
7	RTU AND ASSOCIATED HARDWARE [For Sub-Station (22 / 11 kV & 33/ 11 KV)].....	55
7.1	General Requirement	55
7.2	RTU Functions	55
7.3	Communication ports.....	56
7.4	Communication protocol.....	57
7.5	Technical Parameters of RTUs	57
8	Moulded-Case Circuit Breakers (MCCB)	58
8.1	General	58
8.2	Performance	59
9	Air circuit breaker (ACB).....	59
9.1	General	59
9.2	Performance	59
9.3	Protections.....	59
10	LV Feeder Pillar	60
10.1	General Requirement	60
10.2	Specific Requirement.....	60
11	Specifications of Feeder Pillar Panels.....	60
11.1	Type:1	60
11.2	Type:2.....	61
11.3	Type:3.....	61
11.4	Guaranteed Technical Particulars (GTP) of Feeder Pillars	62
11.5	Earthing.....	63
12	APPROVED MAKES	64
12.1	Compact Packaged Sub-station (CSS)	64
12.2	Ring Main Unit (RMU).....	64
12.3	Dry type transformer in CSS.....	64
12.4	LT switchgear	64
12.5	HT and LT cables	64
13	Annexure.....	65
13.1	Annexure-I: Guaranteed Technical Particulars (GTP) (Sample) for CSS/PSS	65
13.2	Annexure-II: Guaranteed Technical Particulars (Sample) for RMU	82
13.3	Annexure-III: Guaranteed Technical Particulars (Sample) for Feeder Pillars	91

TECHNICAL SPECIFICATIONS FOR “EXTERNAL FIRE SYSTEM”	92
14 General	93
14.1 Applicable Codes/ Standards/ Guidelines	93

List of Tables

Table 1: Summary of Road length in ADB area and SMB to be developed as Smart Roads.....	6
Table 2: List of roads under Smart Roads Ph-2	7
Table 3: List of junctions identified for beautification.....	8
Table 2: Codes and Standards	29
Table 3: Codes and Standards for Compact Sub-station (CSS).....	31
Table 4: Technical Particulars of Compact Sub-stations.....	36
Table 5: Codes and Standards for Transformers	37
Table 6: Applicable Codes and Standards for RMUs	44
Table 7: Technical Particulars for Load Break Isolators.....	49
Table 8: Parameters for Switchgear of DT and LBS	50
Table 9: Technical Parameters of RTUs	57
Table 10: Guaranteed Technical Particulars of Feeder Pillars.....	62

1 Scope of Work

1.1 General

- About 10 KM of roads (exactly 10.185 KM) within the limit of Area Based Development (ABD) and Shillong Municipal Board have been identified for development as “Smart Roads” under the Shillong Smart City project. Project also includes beautification of 12 Nos. of Junctions.
- Geographic details of the Area Based Development and the roads identified under 10 KM “Smart Roads” within ABD limit are given at 1.2 below. For details of proposed design, please refer “Drawings” section of this Bidding Document. Details and drawings given in the Bidding Document for information purpose only and are relevant at Tendering Stage. Actual design for construction may vary.
- These roads are proposed to be developed as “complete streets”, i.e., with proper pedestrian facilities, underground utility ducts (as far as possible and practicable), road signage, landscaping works, etc. through retrofitting. The Junction’s Street space is to be developed to bring people together and invigorate a city, while making traffic more intuitive, seamless, and predictable for its users.

1.2 Location of the roads and Junctions to be developed in Shillong

1.2.1 Roads identified for developed as “Smart Roads”

The total road length of 15.90 km identified to be developed as “Smart Roads” under two phases by Shillong Smart City Limited (SSCL). The summary of road length identified to be developed is as follows:


Table 1: Summary of Road length in ADB area and SMB to be developed as Smart Roads

Parameter	Length (KM)
Total Length of roads within the limit of “Area Based Development” (A)	33.70
Internal roads (i.e. within premises such as Cathedral of Mary, Jail, Polo ground, Police reserve, etc.) (B)	9.70
Narrow roads within Bara Bazaar/ lewduh Market (under jurisdiction of Syiem of Hima Myllem /KHADC) and not to be developed under Shillong Smart City Mission (C)	5.40
New roads (city Dabha to Polo towes (D)	0.50
Roads available to be developed as part of Shillong Smart City (E=A-B-C-D)	18.10
Roads taken up on pilot basis under 6KM “Smart Roads” Phase-I (F)	5.70
Roads to be taken up in “Smart Roads Phase-II” (G=E-F)	10.20
Total Smart Road Length (Phase - I & II)	15.90

The road length stretches to be developed as “Smart Roads” are identified considering the existing roads widths, location and existing utilities based on stakeholder consultations such as PWD, SMB, MePDCL and PHED.

Map of Smart Roads under Shillong Smart City

Figure 1: Identified roads Identified to be developed as Smart Roads under Ph-I & Ph-II

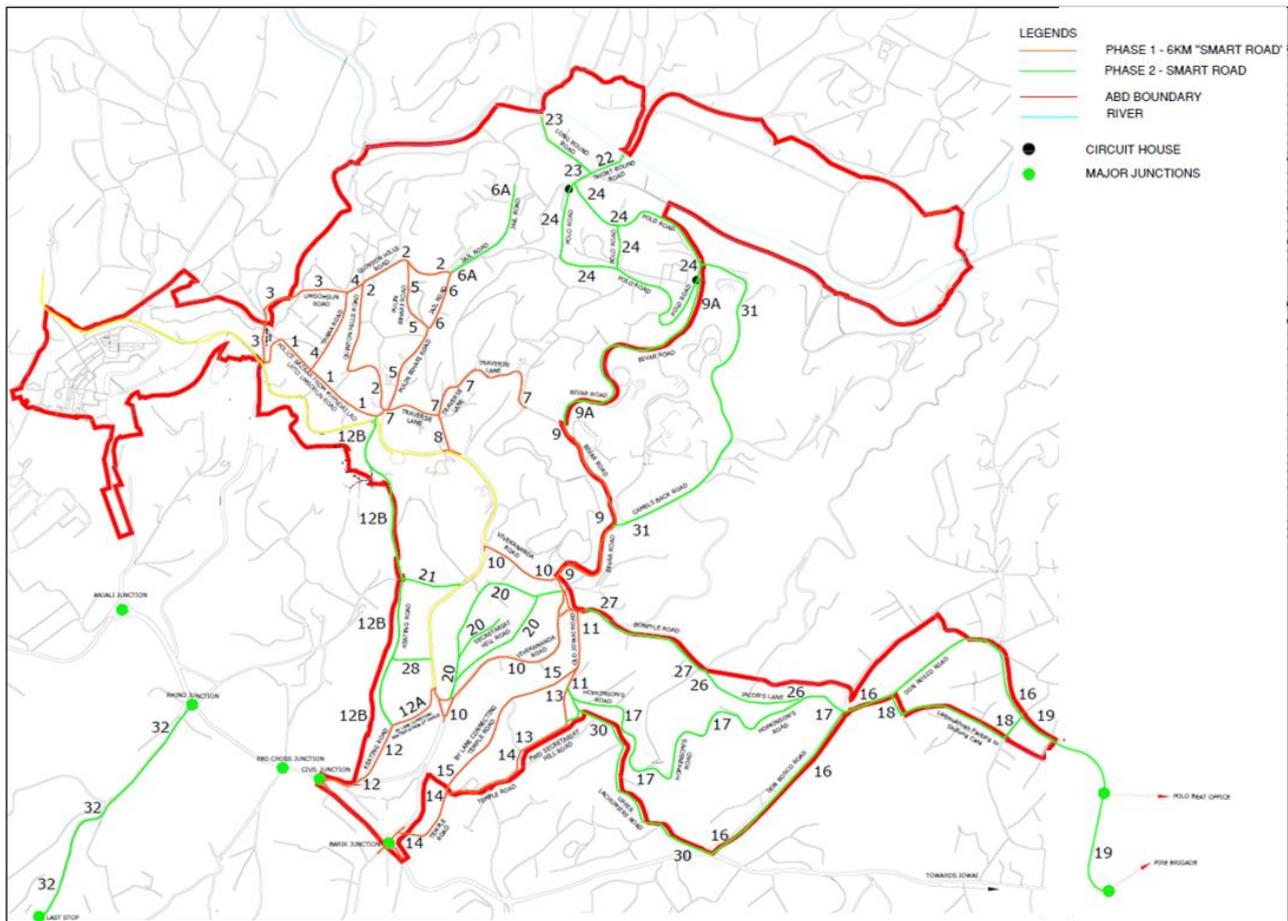

The above map shows a total of 15.90 KM of road length to be developed as “Smart Roads”, it consists of 5.7 kms and 10.2 kms of roads are to be developed under Phase-I and Phase-II respectively.

Details of 10.2 Kms of Smart Roads Ph – II

10 Kms of roads identified are within the areas/ localities of Laitumkhrach/ Polo (commercial/ retail hub), Ward’s Lake (recreational area), and Secretariat Hills/ Upper Lachumiere (institutional/ office area). The list of roads under this phase is as follows:

Table 2: List of roads under Smart Roads Ph-2

S. No.	Road No. in Map	Road Name	Length (M)	Road width (m) (ROW)	Remarks
1	6A	Jail Road	280.00	6.00-6.50	Balance length over and above the part covered under 6KM "Smart Roads"
2	9A	Bivar Road	620.00	10.00	Balance length over and above the part covered under 6KM "Smart Roads"
3	12B	Keating Road	760.00	6.50-8.10	Balance length over and above the part covered under 6KM "Smart Roads"
4	16	Don Bosco Road	1,040.00	10.00-13.00	
5	17	Hopkinson's Road	940.00	5.60-9.10	
6	18	Road from Laitmukhrach Parking to Shillong Café on	380.00	3.80-5.50	

S. No.	Road No. in Map	Road Name	Length (M)	Road width (m) (ROW)	Remarks
		Don Bosco Road			
7	19	Laitmukhrah Market to Fire Brigade via Beat House	560.00	10.00-13.00	Connecting Laitmukhrah Main Road. Outside ABD Area (SMB Limits)
8	20	Secretariat Hill Road	860.00	4.5-6.2	
9	21	Road Passing by the side of Income Tax Office	125.00	5.00	
10	22	Short Round Road	80.00	9.00-11.00	
11	23	Long Round Road	260.00	7.00-10.00	
12	24	Polo Road	1,240.00	7.80-12.00	
13	26	Jacob's Lane	280.00	5.10-4.10	
14	27	Bonfyle Road	360.00	4.60-8.00	
15	28	Street connecting Keating Road and GS road	100.00	5.50	
16	30	Upper Lachumiere Road	560.00	3.90-5.00	
17	31	Camels Back Road (From BSNL Oakland Guest House to Wards Lake)	900.00	7.5-12.00	Connecting to Wards Lake. Outside ABD Area (SMB Limits)
18	32	Rhino Point to Last Stop Market	840.00	7.50-11.00	Outside ABD Area (SMB Limits)
Total Road Length (Kms)			10,185.00		


1.2.2 Major Junctions identified for Beautification under Smart Road Project

There are 12 No. of major junctions that are identified for improvement and beautification, these junctions come within area-based development area and are part of Smart Roads. These are important nodes within the city where major roads intersect and interconnects different areas and localities. The following are the list of junctions which are taken up for redevelopment and beautification.

Table 3: List of junctions identified for beautification.

S.No.	Junction Names
1	Barik Junction
2	Civil Junction
3	IGP point Junction
4	DC Junction
5	Pine Wood Junction
6	Police Bazar roundabout
7	Governor's Junction
8	All Saint's Junction
9	Dhankheti Junction
10	Don Bosco Junction
11	Fire Brigade Junction
12	Polo Junction

Figure 2: Location map indicating all junctions

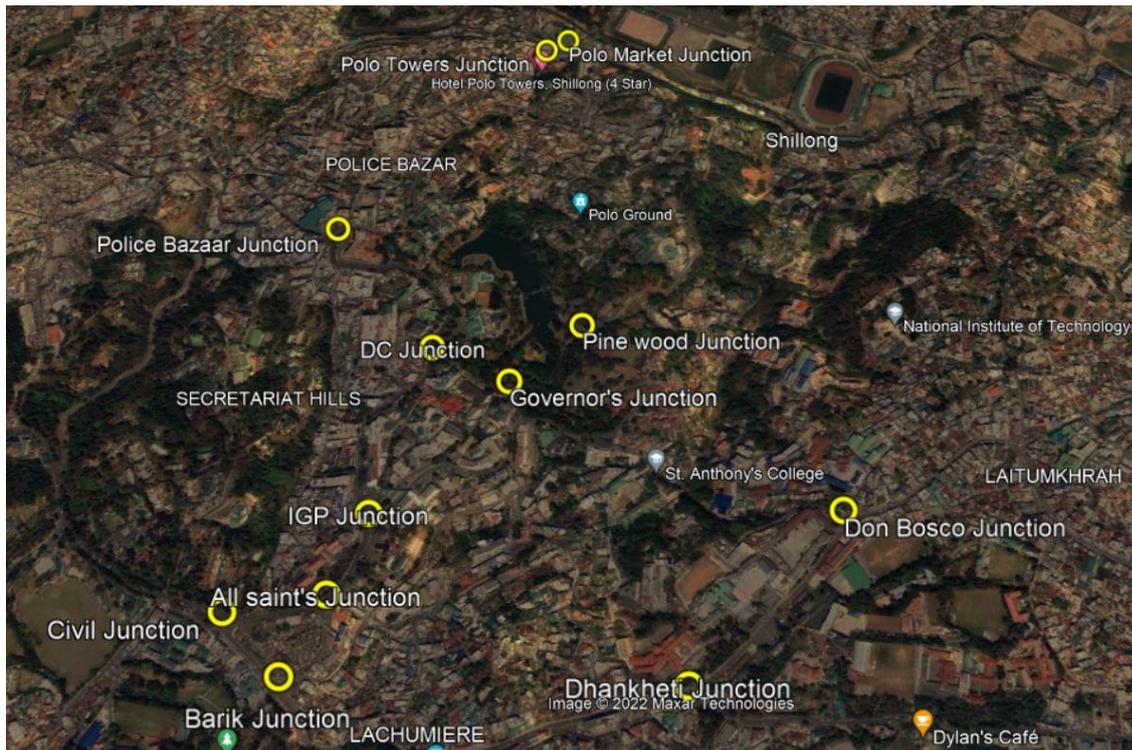

1.3 Detailed Scope of Work

1.3.1 Introductory note / General scope of work

- Scope of work contained in the paragraphs mentioned below is only indicative and not exhaustive. In addition, the contractor shall be responsible for executing all items required for completing the work as per direction of the Engineer-in-Charge. The price quoted shall include all the items and covers all details as may be required to meet the purpose and intents of the contract.
- The design/drawings and cost estimate are for reference only. If required and directed by the Engineer-in-Charge, the contractor will undertake necessary confirmatory Surveys/ Investigations at his own cost, including but not limited to the following:
 - Underground Utility Mapping (Ground Penetrating Radar);
 - Topographic Survey;
 - Geo-technical Investigation, etc.
- Construction related approvals from concerned Authorities will be obtained by the Contractor at his own cost.
- The Contractor shall have to prepare and submit 'As Built Drawings' depicting the exact construction carried out on site, in editable soft (Autocad format) and hard copy (A1 size, coloured in 5 copies) format.
- The Contractor shall also prepare an Operation & Maintenance (O&M) Manual.
- The scope of work is not limited only as mentioned in above paras, but also include to address any exigency generated during tendered work execution and no extra cost shall be paid for the same.

1.3.2 Broad type of works

- The overall scope of work is divided into two parts, namely “civil works” and “electrical works”.
- “Civil works” include retrofitting of the identified existing roads to develop them into “Smart Roads”, such as road pavement (carriageway); Bus Bays; junction improvement works; protected footpaths/ pedestrian walkways; pedestrian plazas; street furniture; road markings; road signages; utility ducts for various utilities such as water supply, power distribution system; communication (telephone and Optical Fiber Cables); landscaping works; storm water drainage including culverts, etc.
- “Electrical works” include all works related to Compact Sub-Stations (CSS) or other type of transformers; Ring Main Units (RMU); Compact Feeder Pillars; HT, LT (overhead or underground), etc.
- External Fire Hydrants: The pipelines and pump rooms are to be provided to develop a network of external fire hydrants across all the road stretches identified to be developed as “Smart Roads”.

1.3.3 Detailed scope under “civil works”

- Dismantling of part/whole of existing road carriageway surface, footpaths, storm water drains, etc. to house the proposed components;
- Excavation for underground utility ducts (such as Water Supply Pipeline Duct and Electrical cum Communication Duct) and Storm Water Drains;
- Plain Cement Concrete (PCC) works as base of utility ducts and storm water drains;
- Formwork;
- Reinforced Cement Concrete (RCC) works as per IS 456:2000 for foundation, side walls and covers (wherever precast covers are not used) of utility ducts and storm water drains. The size and the shape will be as per the respective drawing for different section of roads as shown in drawing. **It is important to mention that specific requirements of concerned Utility Departments/ Agencies will have to be complied with during construction. For example, for Water Supply Pipeline Ducts, the relatively bigger diameter pipelines belonging to PHED will be laid by PHED in the duct first – implying that the ‘U’ portion of the ducts will have to construct first. The top cover will be closed after laying of pipelines by PHED.**
- Storm Water Drains: Scope of work also includes collecting storm water from adjacent properties through pipes of appropriate material and diameter and then discharging that storm water into the proposed storm water drains, as per drawing and direction of the Engineer-in-Charge. It is the responsible of the contractor to interconnect existing drain (inlet or outlet) with the new system as applicable.
- Precast pre-moulded utility ducts/ cable tray (for electrical, communication etc.) including all associated works such as excavation, sand bed, geosynthetics, etc. complete in all respect;
- Structural Steel work within utility ducts to house cables, pipelines etc. (e.g. embedding M.S. angles within the RCC walls);
- Backfilling – with earth and sand (wherever desired compaction is required);
- Construction of footpaths/ pedestrian walkways, pedestrian plazas etc. on top of Storm Water Drains or Utility Ducts or at other locations by means of precast concrete paver blocks / concrete tiles, including lining of ductile tiles for visually impaired persons, as per drawings and direction of the Engineer-in-Charge.
- Guard Rail;
- Embankment – wherever filling is required to maintain proper gradient, as per design and direction of the Engineer-in-Charge.

- Base layers (GSB, WMM) and Bituminous Layers (e.g., Bituminous Macadam, Bituminous Concrete, etc.) for road surface.
- Precast covers and gratings for inspection chambers/ manholes of ducts, Valve chambers, etc.
- Road markings;
- Road signage;
- Landscaping works – both soft-scaping (plantation, lawn, etc.) and hard-scaping (pedestrian plaza, street furniture such as benches, decorative lamps, etc.).

Proposed developments for the junctions are outlined below-

- Redevelopment of Footpaths/Pathways with Cherra Stones and Guard Rail for the safety of pedestrian.
- Beautification of Central Island with provision of landscaping.
- Landscaping areas along footpath (if space available)
- Provision of Road markings including lane markings, embarkment- dis-embarkment markings, pedestrian crossings, stop markings, chevron markings, arrow marking, etc. (Test Report & Samples to be submitted for approval/recommendation prior procurement).
- Bus shelters with seating areas and advertising panels for revenue stream.
- Provision of Police kiosks for controlling and regulating traffic.
- Accommodating signage and street lighting (Test Report & Samples to be submitted for approval/recommendation prior procurement).
- Providing plantation at the rotary for pleasant ambience to commuters along with environmental benefits.
- Installation of Murals/Sculptures/Artifacts/Statues at major intersection wherever possible.
- Application of Road Studs, Solar Studs, flexible bollard, and delineator (Test Report & Samples to be submitted for approval/recommendation prior procurement).
- Resurfacing the existing bituminous area for smoother mobility experience.
- Provision of Refuge Island/Channelizer with physical segregation and paint marking (Ghost Islands).
- Supply, installation, testing and commissioning of Panel Boards, MCB's, Earthing, various light fixtures, concealed wiring as described in the BoQ and drawing including all accessories, for final connections and terminations respectively as per IS Code/Standards at 12 Nos. junctions given in this tender documents.
- Design of control panel shall be such that its accommodation proposal load and nos. of circuits as well as future expansion, if required
- All technical details, representative samples and lux calculation shall be furnished indicating the construction details and standards applicable. Contractor has to submit TDS for all electrical components with samples for approval before procurement.

1.3.4 Detailed scope under “electrical works”

Survey, Design, Supply, Installation, testing & Commissioning of following Compact Sub-station (CSS), Ring Main Unit (RMU), Feeder Pillar Panels, Street Light Poles, Laying of HT and LT Power Cables, Integrating SCADA System, Connection and tapping of cable with existing system (including Factory Acceptance Test, wherever required and/or directed by the Engineer-in-Charge).

- Compact Sub-station (CSS);
- Ring Main Units (RMUs);
- LV Feeder Pillars;
- SCADA integration;
- Field Remote Terminal Unit (FRTU);
- RTU and associated hardware;
- Moulded Case Circuit Breakers (MCCB);
- Air Circuit Breakers (ACB);
- HT Cabling;
- LT Cabling, etc.

1.3.5 Detailed scope under” External Fire Hydrants”

Scope of work contained in the paragraphs mentioned below is only indicative and not exhaustive. In addition, the contractor shall be responsible for executing all items required for completing the work as per direction of the Engineer-in-Charge and also to follow IS standards/codes.

Scope of Work

The scope includes but not limited to survey, design, installation, testing and commissioning of External Fire Hydrant system, Electrical drive pumps, diesel pump, jockey pumps and pipes for Smart Roads. All IS and BIS Standard is mandatory and applies to contractors for the on-site implementation of programs.

The water pipeline for fire hazard safety, running along the road will be placed in the proposed utility duct along with other water lines and connection to external fire hydrant will be provided from the proposed utility duct.

The Contractor shall proceed for procurement of the materials only after seeking approval from the Engineer-In- Charge and Fire & Emergency Department, Shillong.

Fire Fighting Facilities

1. The Contractor shall design the system to provide the required firefighting equipment and facilities conforming to relevant standards and the applicable rules and regulations.
2. Fire safety measures as recommended in applicable codes (Indian as well as International) listed in Technical Specification and shall be implemented. Specifically, the firefighting system shall be adequate to control fire.
3. Specifically, the firefighting system shall be adequate to control fire.
4. The contractor shall obtain all mandatory approvals including prior NOC and post installation approvals and No-Objection Certificate/ Consent for Establishment from Fire and Emergency Department, Shillong at his own cost.
5. After completion of the installation, the same shall be offered for inspection by the representatives of the Fire and Emergency Department, Shillong/ Meghalaya State Fire & Rescue Services and other statutory body(s) as required. The contractor will extend all help including test facilities to the representatives of

statutory body(s). The observations of the statutory body(s) shall be attended by the contractor at his cost. The installation will be commissioned and deemed to be completed only after getting clearance/NOC as above.


6. The contractor shall have to produce all the relevant records to certify that the genuine equipment's from the manufacturers has been supplied and erected.
7. The contractor shall provide reflective signage at External Fire Hydrant in accordance with IRC/IS. The scheme shall be finalized in consultation with Engineer- In- Charge and Fire & Emergency Department, Shillong.
8. The contractor shall construct the fire pump house room to accommodate all units. And the location to be finalized in consultation with Engineer- In-Charge and Fire & Emergency Department, Shillong.
9. The contractor has to prepare and submit as-built drawing for network and location of external fire hydrant with Tag number.

Emergency preparedness

It is essential to identify facilities where emergency preparedness procedures must be implemented. Large facilities like residential office, Commercial area and offices must prepare emergency preparedness of all External Fire hydrant. The external fire hydrant shall be developed on proposed Smart Roads, the proposed external fire hydrant location shall be mark in consultation with the head of Fire and Emergency department, Shillong.

Road network and area of the facility covered (it is mandatory to cover the entire area falling under Smart Road.) under Smart Roads.

Figure 3: Location map indicating all External Fire Hydrant

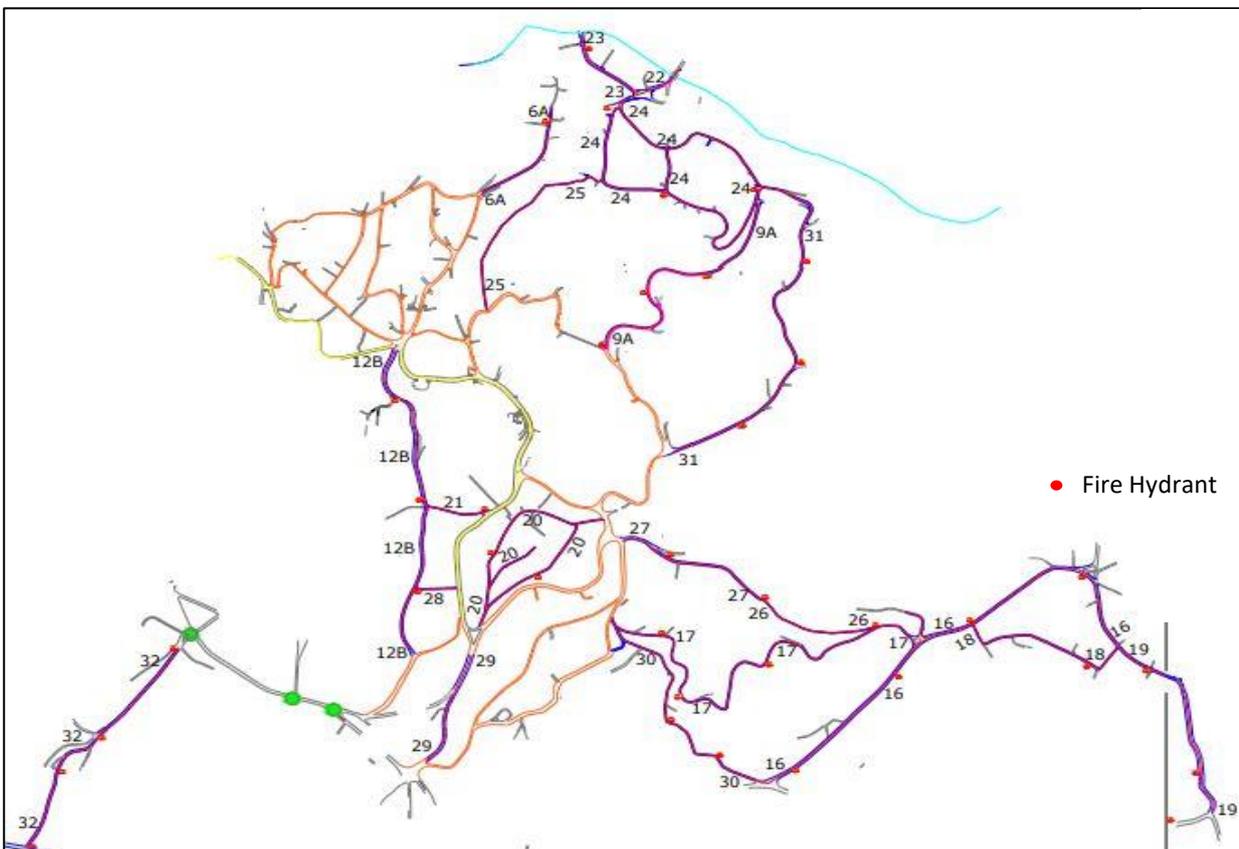

1.4 Utility shifting and provision of temporary service connections during construction - to be done by concerned Departments/ Agencies

For removal of doubt, it is clarified that the scope of work for shifting of utilities, wherever required, and providing temporary service connections during construction stage (if required due to shifting of utilities) is not included in the scope of work of the Contractor for 6KM “Smart Roads”. These are to be done by the concerned Departments/ Agencies. However, the Contractor will extend full cooperation with the other Contractors who may be engaged by the concerned Departments/ Agencies for the utility shifting and temporary connection job. In any case, the Contractor for 6KM “Smart Roads” will be overall responsible for timely completion and accordingly, it will be required on his part that he coordinates with all concerned Departments/ Agencies for speedy utility shifting and provision of temporary connections, so that sufficient work front can be ensured on the ground.

For easy reference, the utilities vis-à-vis concerned Departments/ Agencies are mentioned below:

- Water Supply (transmission lines/ main supply lines): Public Health and Engineering Department (PHED);
- Water Supply (distribution pipelines): Shillong Municipal Board (SMB);
- Power Distribution Lines: Meghalaya Power Distribution Corporation Limited (MePDC);
- Copper Telephone Lines: BSN;
- Communication Cables (OFC): BSNL and respective internet or cable TV service providers (e.g., Reliance Jio, Airtel, Vodafone Idea, Express Wi-Fi, NeLine, etc.).

TECHNICAL SPECIFICATIONS FOR “CIVIL WORKS”

2 General

2.1 Technical Specifications and Work Requirements and order of applicability of various Specifications/ Codes/ Standards/ Guidelines for civil works

The Technical Specifications mentioned below are the minimum required specifications and the Employer/Client reserves the right to select products/material that exceed the specifications. Contractors are required to submit the manufacturer datasheets, wherever applicable.

In order of applicability, the following technical specifications will be applicable:

- a) Specific technical specifications mentioned in this Document will prevail over all other documents mentioned below. For items/works not specifically mentioned in this document, the following will be referred to (in order).
- b) Road works (and other associated works such as RCC works for utility ducts, road signage, etc. whichever is covered) will be governed by the "SPECIFICATIONS FOR ROAD AND BRIDGE WORKS" (FIFTH REVISION) 2013 along with other Addendum/Corrigendum or amendments issued up to 28 days before the final date of submission of the bid, issued by the Ministry of Road Transport and Highways (MoRT&H), Government of India and published by the Indian Roads Congress (IRC), with a cross reference to relevant Bureau of Indian Standards (BIS) for materials or other aspects not covered by the IRC.
- c) Specifications of materials/ works that are not covered in the above-mentioned MoRTH Specifications 2013, will be governed by the latest Specifications Vol. 1 and 2 (2019) along with Addendum/ Corrigendum or amendments issued up to 28 days before the final date of submission of the bid, issued by the Central Public Works Department (CPWD), Ministry of Housing and Urban Affairs (MoHUA), Government of India provided that in case of Storm Water Drains, the works shall conform to CPHEEO manual on Storm Water Drainage System:1999.
- d) Landscaping/ horticulture works will be governed by the specifications as contained in the "DELHI SCHEDULE OF RATES, ANALYSIS OF RATES AND SPECIFICATIONS (HORTICULTURE & LANDSCAPING)" (2018) along with Addendum/ Corrigendum or amendments issued up to 28 days before the final date of submission of the bid, issued by the Central Public Works Department (CPWD), Ministry of Housing and Urban Affairs (MoHUA), Government of India, unless otherwise mentioned hereinunder.
- e) In the absence of any definite provisions on any particular issue in the aforesaid Specifications, reference may be made to the latest codes and specifications of IRC and BIS in that order. Where even these are silent, the construction and completion of the works shall conform to sound international engineering practice as approved by the Engineer-in-Charge.
- f) It is important to note that notwithstanding anything mentioned above, any particular Specification/ Standard/ Guideline/ Code that may be published by concerned Department/ Agency [PWD(B&R), PHED, Water Resources Department, MePDCL, District Administration] or local Authority (SMB) before/during construction of the project will have to be complied with by the Contractor.

2.2 Specifications of items/ works for road works

For ready reference, relevant paragraphs of major works are mentioned below:

S. No.	Type of work	Reference Section in the "Specifications for Road and Bridge Works (Fifth Revision)" published by MoRTH in 2013
1.	Clearing and Grubbing	Section 201
2.	Dismantling Culverts, Bridges and	Section 202

S. No.	Type of work	Reference Section in the “Specifications for Road and Bridge Works (Fifth Revision)” published by MoRTH in 2013
	Other structure/ Pavements	
3.	Excavation for Roadway and Drains	Section 301
4.	Excavation for structures	Section 304
5.	Embankment Construction	Section 305
6.	Soil Erosion and Sedimentation control	Section 306
7.	Turfing with Sods	Section 307
8.	Surface/Sub-Surface Drains	Section 309
9.	Preparation and surface Treatment of Formation	Section 310
10.	Works to be Kept Free of water	Section 311
11.	Rockfill embankment	Section 313
12.	Granular Sub-Base	Section 401
13.	Lime Treated Soil for Improved Sub-Grade/Sub-Base	Section 402
14.	Cement Treated Soil and Cement-Flyash Treated Sub-Base/Base	Section 403
15.	Wet Mix Macadam Sub-Base/Base	Section 406
16.	Cement Concrete Kerb and Kerb with Channel	Section 409
17.	Footpaths and Separators	Section 410
18.	General Requirements for Bituminous Pavement Layer	Section 501
19.	Prime Coat Over Granular - Base	Section 502
20.	Tack Coat	Section 503
21.	Bituminous Macadam	Section 504
22.	Bituminous Concrete	Section 507
23.	Surface Dressing	Section 509
24.	Slurry Seal	Section 512
25.	Fog Spray	Section 513
26.	Crack Prevention Courses	Section 517
27.	Supply of Stone Aggregate for Pavement Courses	Section 520
28.	Quality Control for Road Works	
a.	General	Section 901
b.	Control of Alignment, Level and Surface Regularity	Section 902
c.	Quality Control Test During Construction	Section 903
29.	Materials for Structures	
a.	General	Section 1001
b.	Sources of Materials	Section 1002

S. No.	Type of work	Reference Section in the "Specifications for Road and Bridge Works (Fifth Revision)" published by MoRTH in 2013
c.	Bricks	Section 1003
d.	Stones and Blocks	Section 1004
e.	Cast Iron	Section 1005
f.	Cement	Section 1006
g.	Coarse Aggregate	Section 1007
h.	Fine Aggregate	Section 1008
i.	Steel	Section 1009
j.	Water	Section 1010
k.	Concrete Admixtures	Section 1012
l.	Storage of materials	Section 1014
m.	Tests and Standard of Acceptance	Section 1015
30.	Brick Masonry	Section 1300
31.	Stone and Concrete Block Masonry	Section 1400
32.	FORMWORK	
a.	Materials	Section 1502
b.	Design of formwork	Section 1503
c.	Workmanship	Section 1504
d.	Lining of Formwork	Section 1505
e.	Precaution	Section 1506
f.	Preparation of form Work Before Concreting	Section 1507
g.	Removal of Formwork	Section 1508
h.	Re-Use of Formwork	Section 1509
i.	Tests and Standards of Acceptance	Section 1511
j.	Measurements of Payment	Section 1512
k.	Rate	Section 1513
33.	STEEL REINFORCEMENT	
a.	Description	Section 1601
b.	General	Section 1602
c.	Protection of Reinforcement	Section 1603
d.	Bending of Reinforcement	Section 1604
e.	Placing of Reinforcement	Section 1605
f.	Bar splices	Section 1606
g.	Testing and Acceptance	Section 1607
h.	Measurement for Payment	Section 1608
i.	Rate	Section 1609
34.	STRUCTURAL CONCRETE	
a.	Description	Section 1701
b.	General	Section 1702
c.	Grades of concrete	Section 1703

S. No.	Type of work	Reference Section in the “Specifications for Road and Bridge Works (Fifth Revision)” published by MoRTH in 2013
d.	Proportioning of Concrete	Section 1704
e.	Admixtures	Section 1705
f.	Size of Coarse Aggregates	Section 1706
g.	Equipment	Section 1707
h.	Batching, mixing, transporting, Placing and Compaction	Section 1708
i.	Construction Joints	Section 1709
j.	Concreting Under water	Section 1710
k.	Concreting in Extreme Weather	Section 1711
l.	Protection and Curing	Section 1712
m.	Finishing	Section 1713
n.	Concrete with Blended Cements or Mineral admixture	Section 1714
o.	High Performance Concrete	Section 1715
p.	Tolerances	Section 1716
q.	Tests and Standards of Acceptance	Section 1717
r.	Measurements of Payment	Section 1718
s.	Rate	Section 1719
35.	STRUCTURAL STEEL	
a.	Description	Section 1901
b.	General	Section 1902
c.	Materials	Section 1903
d.	Fabrication	Section 1904
e.	Erection	Section 1905
f.	painting	Section 1906
g.	Tests and Standards of acceptance	Section 1907
h.	Measurements for payment	Section 1908
i.	Rate	Section 1909
36.	Substructure	Section 2200
37.	Concrete Superstructure	Section 2300
38.	Surface and Sub-surface Geotechnical Investigation	Section 2400
39.	River Training Work and Protection Work	Section 2500
40.	Maintenance of Road	Section 3000
41.	TRAFFIC SIGNS, MARKINGS AND OTHER ROAD APPURTENANCES	
a.	Traffic Signs	Section 801
b.	Overhead Signs	Section 802
c.	Road markings	Section 803
d.	Reflective Pavement Markers (Road	Section 804

S. No.	Type of work	Reference Section in the “Specifications for Road and Bridge Works (Fifth Revision)” published by MoRTH in 2013
	Studs) and Solar Powered Road Markers (solar Studs)	
e.	Distance Indicator Posts	Section 805
f.	Road Delineators	Section 806
g.	Boundary Stones	Section 807
h.	Fencing	Section 808
i.	Tubular Steel Railing	Section 809
j.	Structural Steel Railing	Section 810
k.	Crash Barriers	Section 811
l.	Road Traffic signals	Section 812
m.	Traffic Control and Safety Devices in Construction zone	Section 813
n.	Traffic Impact Attenuators	Section 814
o.	Semi-Automatic Toll Collection System	Section 815
p.	Advanced Traffic Management Systems (ATMS)	Section 816

2.3 Specifications of items/ works for other civil works

For ready reference, relevant paragraphs of major works are mentioned below:

S.No.	Type of Work	Reference Para in CPWD Specifications published in 2019
1.	Filling	Para 2.10 of CPWD Spec. Vol 1
2.	Cement Plaster	Para 13.1 of CPWD Spec. Vol 2
3.	Cement Concrete Paver Block	Para 16.57 of CPWD Spec. Vol 2
4.	Kerb Stone	Para 16.58 of CPWD Spec. Vol 2
5.	Random Rubble Stone Masonry	Para 7.1 of CPWD Spec. Vol 1

2.4 Technical Specifications of specific items/ works (non-scheduled)

2.4.1 Injection moulded plastic cable trays/ channels

Injection Molded Cable Trays / channel - Length per pc/per mtr-1000 mm (appx), Width (Internal / External)- 240 mm/340 mm, Height (Internal/External)-155mm/230mm, Minimum Weight – Top & Bottom – 8.2 Kg. Tolerance +/- 2% for dimensions and weight, Material- Polyolefin – Engineering Plastic, -Fire Protection Class K 1 in accordance with DIN 53438 part-2, Load bearing capacity ≥ 15 kN minimum at room Temperature. Each Cable Tray Covers should be with Four Plastic Fastener Locking Device.

2.4.2 Fibreglass Reinforced Polyester Manhole Cover (for covers of Manholes/ Inspection Chambers) and Gratings (for Gully Chambers/ Storm Water Drains beneath carriageway)

- Material: Cross-linked polyesters combined with Fibreglass Reinforced materials of approved make to sustain against wear and tear for heavy load vehicular traffic.
- Load capacity as per IS:1726-1991 & EN-124
 - Light Duty: Test load-2.5 Ton. Suitable for use for areas accessible to pedestrians and bicycles and occasional Light Motor Vehicle traffic.
 - Medium Duty: Test load-10 Ton. Suitable for use under medium-duty vehicular traffic, passenger cars and vehicles of comparable weight including car parking areas.
 - Heavy Duty: Test load-20 Ton. Suitable for use in carriageways with fast moving traffic, including trucks, city trunk roads, bus terminals with heavy duty vehicular traffic.
 - Very Heavy Duty: Test load-40 Ton. Suitable for roads with heavy fire tenders or multi axle trucks.
- Sizes (indicative) for Manhole Covers
 - Storm Water Drain Cover size 600mm x 600mm: Test Load 10T
 - Storm Water Drain Cover Size 450mm x 450mm: Test Load 10T
 - Utility Duct Cover size 1000mm x 1000mm: Test Load 10T
 - Utility Duct Cover size 1000mm x 1000mm: Test Load 40T
- Sizes (indicative) for Gully Chambers/ Grating for Storm Water Drains (where drains are beneath road carriageway)
 - Size 300mm x 300mm: Test Load 40T
 - Size 450mm x 450mm: Test Load 40T

2.4.3 Cationic Bitumen Emulsion (Tack Coat)

Providing and applying RS-1 Cationic Bitumen Emulsion (tack coat) conforming to BIS 8887-2004 at the rate of 0.30 to 0.35 kq/sqm on the prepared non-bituminous surfaces (cement concrete surfaces) cleaned with hydraulic broom complete as per direction of the Engineer-in-Charge.

Important specifications and properties:

- Residue on 600 micron IS sieve % by mass: 0.05% max
- Viscosity @50 degree C (Saybolt), sec: 20-100
- Storage Stability after 24 hours, % max: Less than 2
- Binder-Residue by evaporation: Min 60%
- Settling time: About 15 minutes

2.5 Street-scaping works

2.5.1 Paver Blocks for Footpaths/pedestrian walkway, plaza, parking areas, etc.

For pavements and cycle lanes, providing and laying 60mm thick grey or coloured reflective rubber moulded M-35 Paver blocks over a bed of sand (min. 75mm thick). For car parking areas, providing and laying 80mm thick grey or coloured reflective rubber moulded M-30 Paver blocks over a bed of sand (min. 75mm thick). For

bus bay area's areas, providing and laying 100mm thick grey or coloured reflective rubber moulded M-40 Paver blocks over a bed of sand (min. 75mm thick). Job includes spreading sand on excavated and compacted sub base / PCC bed, compacting sand by ramming and interlocking them with the use of a suitable plate vibrator, job includes all incidental works like cleaning the site of debris, etc.

The paver blocks supplied should adhere to the following requirements: Material – 60 mm (M-35)/ 80mm (M30)/ 100mm (M-40) thick (respectively, as stated above) Rubber Moulded Reflective Paver blocks rough finished conforming to IS-15658:2006 compressive strength and grade. Manufacturer Sirex or equivalent.

Where specified in plan, cycleways are also proposed in 100 mm thick M-20 RCC with minimum reinforcement.

2.5.1.1 Scope of Work:

Excavation and compaction up to 300mm depth for the whole area of pavements/ parking / cycle lanes as per drawing in all sorts of soil including removal and stacking / preserving of top 200mm of 'Top Soil' as per GRIHA standards for top soil preservation. Other loose soil / debris shall be removed / carted from site of excavation up to 5 km. The scope of work shall include supplying and laying of precast paver blocks, at site. Since the site is a public place, care should be taken to ensure that the routine activities shall not be disturbed. The job of laying may need to be carried out during night also for no extra cost. The work shall be executed to perfect line and level as per instructions of Engineer in charge. Coloured concrete paver tiles shall be manufactured and shall adhere to clause 4.4 of IS 15658:2006.

The contractor shall guarantee that all materials and components designed, fabricated and supplied and laid by him shall be free of any type of defects due to faulty material / workmanship / laying / erection for a period of three years from the date of completion of work, which shall be considered defect liability period. Within this defect liability period, the contractor shall render free maintenance failing which the same shall be deducted for the retention cost as per contract. All modes of measurements shall be in Square meters.

2.5.2 Garden / Grass Paver Blocks for Footpath Area

Providing and laying 60mm thick grey or coloured reflective rubber moulded M-30 Grass Paver blocks of 300 x 300 x 60mm or 600 x 400 x 60mm over a bed of Stabilized soil with mulch as per Landscape architects specifications (min. 50mm thick). Job includes spreading sand on excavated and compacted stabilized soil base over compacted sand / PCC bed as specified by Landscape Architect, compacting sand by ramming and interlocking them with the use of a suitable plate vibrator, job includes all incidental works like cleaning the site of debris, etc. Edge protection of paved area using concrete retaining curbs as per Engineers instructions. The paver blocks supplied should adhere to the following requirements:

Material – 60mm thick Rubber Moulded Reflective Paver blocks rough finished of M-30 conforming to IS15658:2006 compressive strength and grade of M-30 meant for light traffic as per Table 1 IS 15658:2006. Manufacturer Sirex or equivalent. Size 600 x 400 x 60mm or 300 x 300 x 60mm as selected by Architect / employer.

2.5.2.1 Scope of Work:

- Excavation and compaction up to 300mm depth for the whole area of Footpath in all sorts of soil including removal and stacking / preserving of top 200mm of 'Top Soil' as per GRIHA standards for top soil preservation. Other loose soil / debris shall be removed / carted from site of excavation up to Municipal dumping yard or as specified by Engineer. The scope of work shall include
- Laying of stabilized soil using conserved top soil mixed with mulch as per specification and compacted using plate compactors to achieve minimum 95 percent Standard Proctor Density per ASTM D 698 for pedestrian areas. Verify subsoils have a permeability between 0.5 and 3.0 inches per hour.
- Verify that geotextiles, if applicable, have been placed in accordance to specifications and instructions of Engineer / Architect.
- Install edge restraints per the drawings and manufacturer's recommendations.
- Supplying and laying of precast Grass paver blocks, at site. Since the site is a public place, care should be taken to ensure that the routine activities shall not be disturbed. The job of laying may need to be

carried out during night also for no extra cost. The work shall be executed to perfect line and level as per instructions of Engineer in charge. Coloured concrete paver tiles shall be manufactured and shall adhere to clause 4.4 of IS 15658:2006.

- The contractor shall guarantee that all materials and components designed, fabricated and supplied and laid by him shall be free of any type of defects due to faulty material / workmanship / laying / erection for a period of three years from the date of completion of work, which shall be considered defect liability period. Within this defect liability period, the contractor shall render free maintenance failing which the same shall be deducted for the retention cost as per contract. All modes of measurements shall be in square meters.

2.5.3 Concrete/ Wall Bench

Concrete Bench Shall as per Approved Drawings. Sitting platform size - 1800 mm length X 450mm width X 50 mm Leg size - 400mm Height X 450mm Width X 150mm. Sitting height is 450 mm (overall) It has to accommodate 3-4 persons comfortably It shall be placed on footpath in a way that the pedestrians pass-by without disturbing the user Materials All components are manufactured using M-30 grade of Concrete using vibro compaction process. All parts shall be joined together with galvanized nuts & bolts of suitable size and all bolts are sealed after assembly.

2.5.4 Bollards

Bollards shall be installed at pedestrian crossing. The bollards are of concrete/cast iron / steel etc & shall serve the purpose of defining the edge of the road and guide pedestrians. Concrete Bollards of M-30 grade, by vibro compaction method using FRP/steel. The Foundation slab shall be made in min. M25 concrete. The bollards shall not be fragile and safely secured to its foundation. All bollards shall be of uniform shape, size, colour on the same width of the road. Overall Dimensions: 918 mm Height X 300 mm Dia. Suitable reinforced to promote long life and to prevent damage during handling, transportation, & erection moulds, so as to achieve shuttering finish.

2.5.5 Tree Grate

The Overall dimensions 1800mm x1800mm x 40/100mm thickness. Suitably reinforced for long use and to prevent damage during transportation & handling. Manufactured with M-30 grade of concrete using vibro-compaction process using joint less FRP moulds so as to achieve shuttering finish on five faces and gurmala finish on the top surface. A choice of standard colours and unlimited custom colours will match any natural stone finish or interlock pavers in the surrounding. The top surface of the tree grates shall be polished.

2.5.6 Bus Stop Waiting Shelter

The technical specification for development of bus shelter are as follows;

- Vertical Pillar Round – 219mmx3mm (2 Nos.)
- Roof Horizontal Pillar- 219 mm x 3mm (1 Nos.)
- Advertisement Panel - (Size- 3600mmx1400mm)
 - a. With 125x50x50mm Box Frame
 - b. Front Door- 75x25 mm Rectangular Pipe
 - c. Front cover- 3mm Solid Polycarbonate Unbreakable
 - d. Back Cover with GI Sheet- 1mm
 - e. Built with Led Tube Lights and All Fittings
 - f. Locking System- LN key Screw
- Capsule Seating- 12 Feet
 - a. Seating Bench Pipe- 16mm & 50mm Dia.
 - b. Connect With 168mm x 3mmdia Pipe
 - c. Seating Backrest Pipe- 141x3mm Pipe

- Location name Front Name Display- 1.5mm Thick sheet – 3000mm x 300mm
- Side – Route Board – 1400x400mm Box
 - a. Door – 75x25xmm, Front Cover – 3mm Solid Polycarbonate Sheet Back- SS Sheet 1.6mm Thick
- Roof Top Structure Frame
 - a. 1900x220mm x3+3 mm Plate Laser cut, Connecting Pipe- 40x40mm Pipe
 - b. Back Channel - 75x25mm, Front Pipe- 100x 50mm
- Roof Top Cover- 10/12 mm Multiwall Polycarbonate Sheet / 3 mm ACP Sheet (Silver/Grey/bronze)
- Base Plate- 350mm x 350 x 12mm Anchor Bolt- 900mm x 16mm

2.5.7 Reflection Flexible bollard/ ABS Movable Delineator

The reflection flexible bollard/ABS Movable Delineator of material ABS and cylindrical in shape, orange in colour of height 750mm and body diameter of 150mm and thickness of 1.5mm. The visibility range of flexible bollard/ABS Movable Delineator in night for 200m. The bollard is inclusive of reflective tape and with all fixtures.

2.6 Planting and Landscaping

2.6.1 Planting of Shrubs, Creepers, Ground Covers

Plant material shall be well formed and shaped true to type and free from disease, insect and defect such as knots, windburn, sun-cold, injuries, abrasion or disfigurement. All plant materials shall be healthy, sound, vigorous with good foliage, and free from plant diseases, insect pests, or their eggs, and shall have healthy well-developed root systems. Plants supplied shall be conforming to the names listed on the plant list. No plant materials will be accepted if branches are damaged or broken. All material must be protected from the sun and weather until planted.

Preparation of soil for grass, ground cover, edges, shrubs and flower beds: Then prepare the same soil with 23" thick layer of well decomposed, weed free farm yard manure or vermicomposting. Treat the soil with chlorophyriphos / Lindane / Neemcake depends upon the infestation of soil borne pests. Treat the soil with proper herbicide to control the weeds only on need basis. Finally level the soil as per the drawing or planting details.

Preparation of pits for shrubs, creepers and hedges : The bed shall be prepared with good earth mixed with 1/3rd quantity of decomposed farmyard manure along with a sampling of shrubs, ground covers, lilies, suckering plants etc. as per design plant spacing – 30-60 cm. maintaining(application of liquid manures/ growth regulators/ pesticides as per need, weeding regularly so as to keep the plant healthy all the time) it for a period of 12 Months from the date of virtual completion of development work

Planting shrub/ground cover- Planting of shrub in the bed prepared earlier by filling garden soil and manure (67:33 ratio). Planting the shrub with root ball in the pit (tin grown / poly bag grown) after removing carefully and without disturbing the root. Pressing the soil firmly around the tree / shrub planted. Preparing the bed around the shrub and watering after staking and tying. Maintenance of shrub/ground cover up to 12(Twelve)months by regular watering and attending the inter-cultivation practices such as weeding, racking, watering gap filling, free of weeds by regular hoeing etc. The plant should be well maintained, disease free, well-trimmed at the time of handing over. In case of death of the plant the contractor needs to replace the same with equally well grown healthy plant. Nurture the shrubs/ground cover with organic solid manures and liquid manures, spray bio-insecticides, parasites, predators to protect the trees from pest and disease. Amend the soil on regular basis with proper soil amendments to keep the pH level between 7 - 7.5.

Planting hedges / edges - Planting of hedge / edge in the ground prepared earlier by filling garden soil and manure. Preparing a pit of require size (for accommodating the root ball of plant) Planting the plants in 2/3 rows (as per instructions) at root ball removed carefully and without disturbing the root ball from poly bag. Pressing the soil firmly around the plant. Preparing the basin for watering. Maintain hedge / edge up to twelve months by regular watering and attending the inter-cultivation practices such as weeding, raking, gap filling,

trimming and pruning etc. The hedge / edge should be well maintained, disease free, well-trimmed at the time of handing over. In case of death of the plant the contractor needs to replace the same with equally well grown healthy plant.

Planting Ground cover - Planting of ground cover plants in the ground prepared earlier by filling garden soil and manure preparing a pit of require size in the ground. Planting the ground cover plant root ball at nine inches apart in the pit after removing carefully and without disturbing the root ball. Pressing the soil firmly around the plant preparing the basin around the plant watering. Maintenance of ground cover up to two months by regular watering and attending the inter-cultivation practices such as weeding, raking, gap filling, trimming and pruning etc. The ground maintained; disease free, well-trimmed at the time of handing over. In case of death of the plant the contractor needs to replace the same with equally well grown healthy plant.

2.6.2 Maintenance Schedule of Planting & Landscaping Works

2.6.2.1 General Obligations

- a. The Contractor shall maintain the works for the maintenance period specified in the Bidding Document.
- b. The extend of the landscape to be maintained by the Contractor shall be deemed to cover and include all softscape landscape areas within the overall project boundaries as shown on the drawings including any existing soft landscape not affected by the Sub-Contract works and retained intact or nearly so through the end of the Sub-Contract period as well as all the landscape works covered in the Sub-Contract scope of works. No additional charges will be allowed unless specifically agreed to by the Landscape Architect in writing.
- c. The Contractor's Horticulturist or Landscape Architect shall inspect the site every day and shall submit report to the Contractor on their actions and closure of the pending works. Also on weekly basis, the Contractor's Horticulturist and Landscape Architect shall prepare a brief schedule of operations planned for the week with target dates.
- d. The daily report and the weekly schedule shall be running record of proposed operations which would be checked at the maintenance inspections every month. If in the opinion of the Landscape Architect/Site- In Charge, the maintenance works have not been satisfactorily carried out according to site conditions and the specifications, the payment will be withheld until the works have been satisfactorily carried out besides the penalty as in the penalty clause.
- i. The Contractor shall take all necessary measures to ensure that all pot plants, trees and shrubs and other plants shall thrive and become established within this period. All landscape areas will be inspected and list of remedial works issued after each inspection. All items on the remedial lists are to be carried out by the time of the next inspection.
- ii. The Contractor shall keep the landscape areas clean and tidy at all times and dispose of all waste materials arising from the cleaning.
- iii. If the Contractors works are found to be unsatisfactory, payment shall be withheld and the maintenance period extended for the period of time that the landscapes maintenance has not been satisfactory. All cost associated with the extension of time shall be borne by the contractor.

2.6.3 Maintenance of Planted Areas: Trees, Shrubs, Climbers, Herbaceous Plants and Groundcovers Including Lawn

- a. The Contractor shall water all trees, palms, shrubs, groundcover, herbaceous plants and other planting areas as often as necessary to keep the ground moist all around and to the full depth of the roots.
- b. All planting beds are to be kept in a weed free condition with a weeding operation as per maintenance schedule or more regularly as required. All weeds, stones and rubbish collected from this operation shall be removed from the site by the Landscape Contractor.
- c. Firming up and adjusting of stakes/ties shall be carried out monthly to ensure that the trees and shrubs are firmly held in ground. If required, guy ropes or tree ties shall be adjusted, tightened or loosened. If tree ties or

ropes are rubbing the bark of the trees, the ties are to be taken off and retied. Any damaged branches are to be carefully pruned and the wounds sealed.

- d. All protective fencing is to be maintained and kept in good condition as long as required on site.
- e. All shrubs and groundcovers are to be reviewed monthly and pruned as and when required during the Maintenance Period to promote bushy growth and good flowering characteristics. The shrubs shall be checked and all dead wood, broken, damaged or crossed branches shall be cut back, depending on species.
- f. The Contractor shall on continual basis supervise and attend to fertilizer needs/disease control/termite or fungus control as maintenance operations during the entire period of contract an approved fertilizer/insecticides/pesticide shall be applied to each plant.
- g. The Contractor shall make regular weekly checks to ensure that the plant material is insect and pest and free.

2.6.4 Maintenance of Lawn Areas

The lawn shall be trimmed and maintained properly without any weeds.

2.6.4.1 Details of Periodic Maintenance Activities

SL. NO	OPERATION	FREQUENCY (TIMES)	PERIOD/DURATION AFTER HANDING OVER
1	Irrigation		As per Demand or as specified under
(a)	In Summer	15	Month- Every Alternate day
(b)	In Rainy Season	5 to 7	Monthly or as per climatic condition
(c)	In Winter	10	Monthly

2.6.4.2 Staking & Supports

Stakes shall always be used when planting instant trees, standards and single stem palms and for tall shrubs as indicated in the drawings and the Stakes shall be mangrove poles, bamboo or equal and shall be appropriate to the size of the plant to be supported.

2.6.4.3 Protection Of Planted Areas

The Landscape Contractor shall take all necessary precautions to prevent or eradicate any outbreak of disease or insect attack, The Contractor shall be responsible for protecting all planted areas. If it is necessary for the Contractor to erect temporary protective fencing, the Contractor shall be responsible for keeping the fencing in position and in good repair until the end of the maintenance period. Fencing proposals shall be submitted to the Landscape Architect for approval.

2.6.4.4 Maintenance Prior To Completion

- i. After planting and prior to the onset of the maintenance period, the Landscape Contractor shall be responsible for carrying out all necessary measures to ensure that the plant material thrives and becomes established and that the landscape areas are kept in a clean and tidy condition.
- ii. The Contractor shall allow for carrying out the following maintenance operations, when necessary, prior to the onset of the maintenance period, all as specified in section 7 of this specification
 - o Replacement of dead/missing plants
 - o Grass cutting
 - o Watering
 - o Cultivation and loosening of soil
 - o Weeding
 - o Pruning and clipping

- Firming up and adjustment stakes and ties
 - Eradication of pest or insect attack
 - Top drawing and mulching
 - Fertilizing
- iii. The Contractor shall be responsible for replacing any plants which fail to survive as a result of inadequate maintenance operations, poor workmanship or poor quality of plant material prior to completion
- iv. The Certificate of completion will not be issued until all plans scheduled on the Drawings and Schedule of Works are installed in a healthy condition in the manner specified.

TECHNICAL SPECIFICATIONS FOR “ELECTRICAL WORKS”

3 General

3.1 Applicable Codes/ Standards/ Guidelines

The following Codes/ Standards/ Guidelines will be applicable (in order of applicability, i.e. if specification of an item/ work is not available in a particular Code/ Standard/ Guideline, then the immediate next one will be applicable):

- a) Guidelines of the Meghalaya Power Distribution Corporation Limited (MePDCL) or Meghalaya Energy Corporation Limited (MeECL)
- b) BIS: Bureau of Indian Standard
- c) IEC: International Electro technical Commission standards
- d) IEEE: Institute of Electrical and Electronics Engineers standards
- e) Regulations laid down by Indian Electricity Act and Rules National Electrical Code (SP 30, 2011) of India
- f) Indian Bureau of Energy Efficiency (BEE) Guidelines
- g) Guidelines issued by Central Electricity Authority (CEA) CBIP Publications

Any other applicable regulations by the local or state/central government authorities, regulations issued by tariff advisory committee / fire insurance regulations.

Table 4: Codes and Standards

IS Codes and IEC Standards	
IS 3043/IEEE-80	Code of Practice for Earthing
IS/IEC-60947	LV Switchgear
IEC 62271-202	HV Prefabricated Sub-Station (CSS)
IS 3427 / IEC-62271-200	Metal Clad Switchgear
IS 13118/ IEC-62271 - 100	HV Circuit Breakers
IS 11171 (1985)	Cast Resin Dry Type Transformer
IS 5578	Arrangement for Switchgear Bus bars, Main Connection and Auxiliary Wiring
IS 2705	Current transformer
IS 3156	Potential transformer
IS 2544	Bus bar support insulators
IS 3231	Electrical Relays for Power System Protection

IS Codes and IEC Standards	
IS 13703	HRC FUSES
IS 3646	Code of Practice for interior illumination
IS 1944	Code of Practice for road lighting
IS 2309	Protection of buildings and allied structures against Lightning code of Practice
IS 7098	Specification for XLPE insulated PVC sheathed cables
IS 1554	Specification for PVC insulated cables
IEC: 62259	Secondary cells and batteries containing alkaline or other non-acid electrolytes-Nickel-cadmium prismatic secondary single cells with partial gas recombination
IEC: 60623 / IS 10918	Secondary cells and batteries containing alkaline or other non-acid electrolytes-vented Nickel Cadmium prismatic rechargeable single cells
IS 9000	For Basic climatic and mechanical durability tests for components for electronic and electrical equipment
IS 6619	For Semiconductor rectifier equipment code
IS 2026	Power transformers
SP 72: 2010	National Lighting Code
1944 (Parts 1 Code of practice for lighting of and 2)	Public thoroughfares: Part 1 General principles; Part 2 Lighting of main roads
1944 (Part 5) : 1981	Code of practice for lighting of public thoroughfares: Part 5 Lighting of grade separated junctions, bridges and elevated road (Group D)
1944 (Part 6): 1981	Code of practice for lighting of public thoroughfares: Part 6 Lighting of town and city centres and areas of civic importance (Group E)
CEA	Manual on Transmission planning Criteria

Note: Other International codes and standards shall be considered if the same are, at least equivalent to, Indian Standards or any other international standard which yields a more desirable outcome.

3.2 General Requirements to be complied with by the Bidders

- Tender specific Manufacturers Authorization letter for key items such as HT cable, Package Sub-station, Ring Main Unit (RMU), SCADA etc. signed by Original Equipment Manufacturer (OEM) must be submitted by the bidders at the time of bid submission.

- The Bidder must submit point by point compliance to the tender technical specification as per bid document to avoid bid rejection.
- In case the Bidder is an OEM authorized design partner, the performance certificate /POs of the OEM shall suffice.

4 Compact Sub-station (Prefabricated Packaged Sub-station)

All equipment and material shall be designed manufactured and tested in accordance with the latest applicable IEC standards. The 12KV Package Sub-station Design must be as per IEC62271-202.

The Prefabricated Package Sub-station offered shall in general comply with the latest issues including amendments of the following standards.

Table 5: Codes and Standards for Compact Sub-station (CSS)

Title	Standards
High Voltage / Low Voltage Prefabricated Sub-station	IEC: 61330/IEC 62271-202
High Voltage Switches	IEC 60265
Metal Enclosed High Voltage Switchgear	IEC 60298/ IEC62271-200
High Voltage Switchgear	IEC 60694
Low Voltage Switchgear and Control gear	IEC 60439
Distribution Transformer Losses and Impedance	IS-11171 (AS PER ECBC 2017)

4.1 Design Criteria

Package Sub-station consisting of 11KV Non-Extensible SF6 Ring Main Unit with breaker as protection + **Transformer + Low Voltage Switchgear** with all connection accessories, fitting & auxiliary equipment inside an internal arc type tested single enclosure to supply Low-voltage energy from high-voltage system as detailed in this specification. The complete unit shall be installed on a Sub-station plinth (base) as **Outdoor Sub-station** located at very congested places. 11KV Isolators controls incoming-outgoing feeder cables of the 11KV distribution system. The Vacuum Circuit Breaker shall be used to control and isolate the 11kV/433V Distribution transformer. The transformer Low Voltage side shall be connected to Low Voltage switchgear. The connection cables to consumer shall be taken out from the Low Voltage switchgear.

The prefabricated-package Sub-station shall be designed for a) Compactness, b) fast installation, c) maintenance free operation, d) safety for worker/operator & public. The Switchgear and component thereof shall be capable of withstanding the mechanical and thermal stresses of short circuit listed in ratings and requirements clause without any damage or deterioration of the materials. For continues operation at specified ratings temperature rise of the various switchgear components shall be limited to permissible values stipulated in the relevant standard and / or this specification.

4.2 Service Conditions

The Package Sub-station shall be suitable for continuous operation under the basic service conditions indicated below

- Ambient Temperature: 40 Deg C

- Relative Humidity: up to 95%
- Altitude of Installation up to 1500 mtrs

The Enclosure of High Voltage switchgear-control gear, Low Voltage switchgear-control gear & Transformer of the package Sub-station shall be designed to be used under **normal outdoor service condition** as mentioned.

The enclosure should take minimum space for the installation including the space required for approaching various doors & equipment inside. Transformer compartment inaccessible from outside considering public safety and can be accessed only after removing the bolted covers for PSS upto 1000kVA rating.

4.3 Specific Requirement

The main components of a prefabricated- package Sub-station are Transformer, High-voltage switchgear-control gear, Low-voltage switchgear-control gear and corresponding interconnections (cable, flexible, bus bars) & auxiliary equipment. All the components shall comply with their relevant IEC standards.

The PSS supplied through Contractor/Consortium or OEM or Licensee Partner of OEM, should house HT /LT components in a common enclosure tested for “AB” category with an IAC rating of 21kA for 1 sec and temperature rise as per IEC 62271-202, tested in an International/National Government Lab/ Recognized Laboratory.

Since it is a compact Sub-station, all the equipment like RMU, Transformer, LT switchgear with all connection, accessories, fittings shall be mounted within a pre-fabricated common enclosure having a common roof as outdoor Sub-station for better performance and safety. No assembled enclosure shall be allowed which leads to failure of PSS.

4.4 Rating

SN	Description	Unit	Value
1.	Rated Voltage / Operating Voltage	kV rms	11
2.	(a) Rated frequency & Number of phases	Hz & nos.	50 & 3
3.	(b) Rated maximum power of Sub-station	kVA	630 kVA / 500kVA
4.	(c) Rated Ingress protection class of Enclosure	IP	IP-23 for Transformer Compartment and IP: 54 for LT & HT Switchgear Compartment.
5.	(d) Rated temp Class of Transformer Compartment		K10 up to 1250kVA
6.	Rated withstand voltage at power frequency of 50 Hz	kV rms	28
7.	Rated Impulse withstand Voltage	kV peak	75
8.	Type of Tap Changer for giving		Off circuit tap links

SN	Description	Unit	Value
	Voltage variation to HV		
9.	Tapping Range		+5% to -5% instep of 2.5%
10.	HV Network & Busbar		
11.	Rated current	Amp	630A
12.	Rated short time withstand current	kA rms / 3 sec	21
13.	Making capacity for switch-disconnector & earthing switches	kA peak	50kA
14.	Breaking capacity of Isolators (rated full load)	A	630A
15.	(g) LV Network		As per BOQ
16.	Fitting for Dry Type		2 Numbers Earthing Terminals, Rating and Diagram Plate, Bi-Directional Rollers, Lifting Lugs, Winding Temp Scanner.

4.5 Specifications of Compact Sub-stations and their tentative locations

SN	Material Description	Tentative locations for reference of the Bidders
1	<p>Supply, Installation, Testing and Commissioning of 11kV, 630 KVA, Outdoor Package / Compact Sub-Station (in compliance IEC 62271-202) shall be consisting of following:</p> <p>HT Switchgear: 11KV, 630A, 21KA for 3 Sec SF6 Insulated SCADA compatible / Integrable RMU [4 way] consisting of 2 nos. remote operated motorised Load Break Switch and 2 no. remote operated motorised VCB unit with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with Multi Functioning Meters each VCB feeder.</p> <p>Transformer: 11/ 0.433kV, 630 kVA, Dry type Transformer [Losses as per latest ECBC], Class of Insulation-F with temperature rise limit to 90 Deg C, over an ambient of 50 Deg C, 9kV,5kA Surge arrester on transformer HV</p> <p>LT Section: I/C-1 No - 1000A 433V, 4Pole, 50Hz, 50KA, electrically operated type ACB. O/G - 5 nos. 250A, 433V, 3Pole, 50Hz, 36KA MCCB, Microprocessor based. numerical relay and metering unit with CTs and PTs with Multi Functioning Meters each MCCB feeder</p>	<p>Mi-Casa Hotel, Little Blossom School, Jail Road, St. Antony College, MePDCL Polo Division Premises, SGRT (Sport Ground), Polo Junction (near Polo Tower), BSNL - Oakland Guest House), Camel's Back (Behind Pinewood), Last Stop, Oxford Junction, Garrison Ground, Laitumkhrah Market</p>

SN	Material Description	Tentative locations for reference of the Bidders
	<p>Complete PSS enclosure with GI and thickness as 1.6/2mm and base as ISMC Channel. PSS should have valid Type test for IAC AB. 21KA for 3 sec. FRTU shall be integrated to SCADA for remote monitoring (HT & LT) and control (HT). Thermal sensors should be provided in the cable chamber of Ring main unit, Transformer terminations and LV bus/Incomer. Humidity sensor should be provided in the transformer compartment. All the sensors shall communicate with FRTU for remote SCADA monitoring through a sensor Data concentrator. PSS Manufacturer should have valid TYPE TEST REPORTS.</p>	
2	<p>Supply, Installation, Testing and Commissioning of 11kV, 500 KVA, Outdoor Package / Compact Sub-Station (in compliance IEC 62271-202) shall be consisting of following:</p> <p>HT Switchgear: 11KV, 630A, 21KA for 3 Sec SF6 Insulated SCADA compatible / Integrable RMU [4 way] consisting of 2 nos. remote operated motorised Load Break Switch and 2 no. remote operated motorised VCB unit with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with Multi Functioning Meters each VCB feeder.</p> <p>Transformer: 11/0.433kV, 500 kVA, Dry type Transformer [Losses as per latest ECBC], Class of Insulation-F with temperature rise limit to 90 Deg C, over an ambient of 50 Deg C, 9kV,5kA Surge arrester on transformer HV</p> <p>LT Section: I/C-1 No - 800A 433V, 4Pole, 50Hz, 50KA, electrically operated type ACB. O/G - 5 nos. 200A, 433V, 3Pole, 50Hz, 36KA MCCB, Microprocessor based. numerical relay and metering unit with CTs and PTs with Multi Functioning Meters each MCCB feeder</p> <p>Complete PSS enclosure with GI and thickness as 1.6/2mm and base as ISMC Channel. PSS should have valid Type test for IAC AB. 21KA for 3 sec. FRTU shall be integrated to SCADA for remote monitoring (HT & LT) and control (HT). Thermal sensors should be provided in the cable chamber of Ring main unit, Transformer terminations and LV bus/Incomer. Humidity sensor should be provided in the transformer compartment. All the sensors shall communicate with FRTU for remote SCADA monitoring through a sensor Data concentrator. PSS Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>Boy's Road - 02 No's, Beat House – 2 Nos. Veronica Lane (opp. Habitat) - 2Nos. Police Point (Inside Pvt. Parking)- 1Nos.</p>

SN	Material Description	Tentative	Locations	for reference of the Bidders
3	<p>Supply, Installation, Testing and Commissioning of 11kV, 500 KVA, Outdoor Package / Compact Sub-Station (in compliance IEC 62271-202) shall be consisting of following:</p> <p>HT Switchgear: 11KV, 630A, 21KA for 3 Sec SF6 Insulated SCADA compatible / Integrable RMU [4 way] consisting of 1 no. remote operated motorised Load Break Switch and 3 no. remote operated motorised VCB unit with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with Multi Functioning Meters each VCB feeder.</p> <p>Transformer: 11/ 0.433kV, 500 kVA, Dry type Transformer [Losses as per latest ECBC], Class of Insulation-F with temperature rise limit to 90 Deg C, over an ambient of 50 Deg C, 9kV,5kA Surge arrester on transformer HV</p> <p>LT Section: I/C-1 No - 800A 433V, 4Pole, 50Hz, 50KA, electrically operated type ACB. O/G - 5 nos. 200A, 433V, 3Pole, 50Hz, 36KA MCCB, Microprocessor based. numerical relay and metering unit with CTs and PTs with Multi Functioning Meters each MCCB feeder</p> <p>Complete PSS enclosure with GI and thickness as 1.6/2mm and base as ISMC Channel. PSS should have valid Type test for IAC AB. 21KA for 3 sec. FRTU shall be integrated to SCADA for remote monitoring (HT & LT) and control (HT). Thermal sensors should be provided in the cable chamber of Ring main unit, Transformer terminations and LV bus/Incomer. Humidity sensor should be provided in the transformer compartment. All the sensors shall communicate with FRTU for remote SCADA monitoring through a sensor Data concentrator. PSS Manufacturer should have valid TYPE TEST REPORTS.</p>	MePDCL Premises)	(CSDS	Division

4.5.1 Minimum requirements of Compact Sub-stations

- PSS Enclosure must be type tested for IAC A & B (Operator & Public Safety) 21kA/1 sec.
- Ring Main unit should have LBS /earth switch rated for M1(1000 O/C) and E3 (100 op); Breaker with 2000 mechanical/electrical operations and more than 30 short circuit operations.
- RMU should have Auto Transfer Source Functionality between two LBS Function of RMU via FRTU.
- FRTU and SCADA software shall be of same make for the ease of integration with MePDCL / ICCS SSCL SCADA System.
- Trip status of LV components shall be integrated to SCADA.
- Out of 3 major components in CSS (RMU, Transformer, ACB, VCB, SCADA/FRTU) at least 2 of them shall be of same make.
- The disconnecter and earthing switch of the breaker function shall be provided at the cable side and earth switch should be rated for making duty. Type test reports on making capacity, short-time withstand current and peak short-circuit current shall be supplied. Earthing through breaker shall not

be acceptable.

- Separate enclosure should be provided for mounting FRTU, battery and battery charger along with related accessories.
- Access to the cable chamber shall be through front only, no side or rear access shall be acceptable.
- CT shall be mounted on separate CT mounting plate, without putting pressure on the cable bushings of the RMU.
- Proper cable support provisions shall be provided for termination of the cable, in addition to the cable clamp provided along with the gland plate. Minimum termination height of around 600 mm should be provided for terminating 11kV cables.
- Manufacturer to declare the make of vacuum interrupter offered is same as used in type tests
- ACB /MCCB shall have Rated service short circuit breaking capacity $I_{cs} = I_{cu} = I_{cw}$ (1sec)
- ACB shall have minimum Mechanical life of 20,000 operations
- All ACB's in main LT panel shall be provided with zone selective interlocking which helps in reducing the thermal and dynamic stress on installation during short circuit and ground faults.
- Thermal sensors should be provided in the cable chamber of Ring Main Unit, Transformer terminations and LV bus/Incomer. Humidity sensor should be provided in the transformer compartment. All the sensors are to communicate sensor data concentrator through Zigbee, which shall further communicate with FRTU for remote SCADA monitoring through MODBUS RTU connection.
- Fire extinguisher (1no.) shall be kept in the compact Sub-station.

4.5.2 Technical particulars for Compact Package Sub-Stations

Table 6: Technical Particulars of Compact Sub-stations

SN	Particular	Details
1.	Rated Voltage / Operating Voltage	12/11 kV rms
2.	Rated frequency & Number of phases	50 Hz & 3
3.	Rated power of the Sub-station	500/630 KVA Cast Resin Dry type
4.	Rated Ingress protection class of the enclosure	IP-23/IP34 for Transformer Compartment and IP: 54 for LT & HT Switchgear Compartment
5.	Rated temp Class of Transformer Compartment	K10
HV Insulation Level		
6.	Rated withstand voltage at power frequency of 50 Hz	28 kV rms
7.	Rated Impulse withstand Voltage	75 kV peak

SN	Particular	Details
HV Network & Bus bar		
8.	Rated Current	630 Amps
9.	Rated Short Time Withstand Current	21 kA rms / 3 Sec.
10.	Making Capacity for Switch Disconnecter & earthing switches	50 kA peak
11.	Breaking capacity of Isolators (rated full load)	ps

4.6 Technical Specifications of Transformers

4.6.1 Applicable Codes and Standards for Transformers

The equipment covered by this specification is, (unless otherwise stated to be designed), constructed and tested in accordance with latest revisions of relevant Indian standards / IEC publications.

Table 7: Codes and Standards for Transformers

SN	Standard Code	Description
1.	IS 1271	Classification of Insulating Materials
2.	IS 2026	Power Transformers (Part I - V)
3.	IS 2099	Bushing for Alternating Voltages above 1000 V
4.	IS 2705	Current Transformers
5.	IS 3202	Code of practice for climate proofing
6.	IS 3639	Power transformer fittings and accessories
7.	IS 4257	Porcelain bushings for transformers
8.	IS 11171	Dry type Transformer
9.	IS 8478	Application guide for tap-changers
10.	IS 10028	Code of practice for selection, installation and Maintenance of transformers

4.6.2 General Design Features

- The transformers shall be of the latest design, dry type Cast Resin.
- The type of cooling is Natural Air cooled (AN) and the corresponding ratings for each transformer shall be provided by the customers.

- Each transformer is suitable for operation at full rated power on all tapings without exceeding the applicable temperature rise.
- It is possible to operate the transformer satisfactorily, with the loading Guide specified in IS-6600. There are no limitations imposed by bushings, tap changers, and auxiliary equipment to meet this requirement
- The transformers are designed to be capable of withstanding, without damage, the thermal and mechanical effects of short-circuits between phases or between phase and earth at the terminals of any winding with full voltage applied across the other winding for periods given in relevant standards.
- The transformer/off load tap links are able to meet the short circuit level specified (as mentioned in technical specification) without permanent damage.
- Each transformer is designed for minimum losses as per ECBC latest guideline.
- All electrical connections and contacts are of ample cross sections for carrying the rated current without excessive heating.
- The transformer is capable of continuous operation at full load rating under the following conditions.
 - ✓ Voltage variation = +/- 10%
 - ✓ Frequency variation = +/- 5%
 - ✓ Combined voltage and frequency variation (Absolute sum) = 10%

4.6.3 Construction

The transformer shall be dry type, AN cooled suitable for Compact Package Sub-station application.

The core-clamping frame shall be provided with lifting eyes having ample strength to lift the complete core and winding assembly.

Off circuit tapings shall be provided on the HV windings. Tap changing is done by means of off circuit links accessible through openings provided.

The lifting lugs and rollers shall be provided. A winding temp. Scanner shall be provided and is actuated by means of resistance temperature detectors embedded in LV windings of all three phases. It should have alarm and trip contacts at a specified temperature.

The transformer shall be suitable to be installed in the transformer compartment of package Sub-station having IP34 protection class.

4.6.4 Windings

- The winding insulation is of Class 'F' and temperature rise limit to Class F. i.e. 90 deg. C. Windings are of electrolytic copper conductors (circular in shape) of high conductivity and 99.9% purity.
- Windings are designed to withstand the specified thermal and dynamic short circuit stresses.
- The windings are duly sectionalized. No corona discharge result on the winding upon testing the transformer for induced voltage test as specified in IS.
- The end turns of the high voltage windings have reinforced insulation to take care of the voltage surges likely to occur during switching or any other abnormal condition.
- The high voltage and low voltage winding are made of copper Conductors

4.6.5 Core and Coil

- The double wound Core is constructed from non-ageing cold rolled Grain oriented steel sheets.

- The built core is painted with high temperature resistant paint to prevent corrosion at the edges of core plates and to withstand high temperatures.
- By using different core material optimization of core losses can be achieved.
- The yokes are firmly clamped between yoke channels or plates.
- The design of the magnetic circuit is such as to avoid static discharges, development of short circuit paths within itself or to the earthed clamping structure and the production of flux component at right angles to the planes of laminations which may cause local heating.

4.6.6 **Losses**

The maximum allowable losses at rated voltage and rated frequency shall be as ECBC-2017.

4.6.7 **Off-Circuit Tap Changing Links**

- Off circuit tapings are provided on HV windings. Tap changing is done by means Off circuit links.
- Use of tap changing links eliminates any moving parts as against a manually operated tap changer.

4.6.8 **Terminal Arrangement**

- HV side and LV side of transformer will have the top bus bar arrangement for connection of HT side by means of cable and LT side by means of bus bar.

4.6.9 **Painting**

- All steel surfaces are thoroughly cleaned by sand blasting or chemical agents as required to produce a smooth surface free of scale, grease and rust.
- The external surface, after cleaning, is given a coat of high-quality red oxide or yellow quoted primer, followed by filler coats.

4.6.10 **Routine Test:**

All Routine Tests in accordance with IEC 60076 / IS 2026 are carried out on each transformer.

4.6.11 **Nameplate**

Each transformer is provided with a nameplate of weather resistant material fitted in a visible position showing but not limited to the following item:

- Kind of transformer
- Number of the specification
- Manufacturer's name
- Year of manufacture
- Manufacturer's serial number
- Number of phases and frequency
- Rated power
- Rated voltages and currents
- Connection symbol

- Impedance voltage at rated current
- Type of cooling
- Total weight
- Weight of insulating oil
- Class of insulation
- Temperature rise
- Connection diagram
- Insulation levels
- Weight of transportation
- Details regarding tapping's

4.6.12 Technical Particulars for Dry Type Transformers

SN	Particular	Details
1.	Type	Three Phase, 50 Hz, Core type, two winding, Cast Resin Dry type Transformer
2.	Make	ABB/ Raychem / Schneider Electric/ Siemens / Voltamp
3.	Rating	500 / 630 kVA
4.	Winding Material	Copper
5.	No load voltage ratio	11kV/433V
6.	Connection HV LV	Delta Star with neutral
7.	Vector Group	Dyn 11
8.	Insulation level (KVp/ KVrms) HV LV	75 / 28 - / 03
9.	Type of Tap Changer for giving voltage variation to HV	Off circuit tap links
10.	Tapping Range	+5% to -5% in steps of 2.5%
11.	Temperature rise winding over ambient temperature	90° C

SN	Particular	Details
12.	Class of insulation	Class 'F'
13.	Enclosure	IP 00 (without enclosure)
14.	Method of Cooling	AN (Air Natural)
15.	Max. No load losses at rated voltage & frequency (IS Tol)	Min. Watts
16.	Max. Full load loss at principle tap at 75° C (IS Tol.)	Min. Watts
17.	Termination HV LV	Busbar Busbar
18.	Fittings for Dry type	2 Numbers Earthing Terminals, Rating and Diagram Plate, Bi-Directional Rollers, Lifting Lugs, Winding Temp Scanner.
19.	Paint	Enamel-RAL 7032

4.7 SCADA

4.7.1 General

- Furnish a dedicated, edge control, software platform (The Software Platform) that is purpose-built to be the operational interface for a Power Management and Control System (PMCS) whose primary purpose is to support the provision and management of safe, reliable and efficient power within buildings and facilities. The Software Platform shall have specialized data acquisition, visualization, analysis and reporting tools specifically designed for Power Management applications such as:
 - Source and Network Control
 - Electrical Distribution System Monitoring and Alarming
 - Electrical System Capacity Management
 - Power Quality Monitoring and Compliance
 - Multi Source Management
 - Continuous Electrical Thermal Monitoring
 - Breaker Setting Monitoring
 - Backup Power Testing.
 - Power Events Analysis.
 - Energy Usage Analysis and Energy Benchmarking.
 - Utility Bill Verification and Cost Allocation.

- Energy Performance Analysis and Verification.
- The Software Platform shall be certified to comply with cybersecurity standard IEC62443 SL1 at the component level: IEC62443-4-1 and IEC62443-4-2.
- The Software Platform shall natively support the vendor's continuous electrical thermal monitoring system with the ability to detect abnormal bus bar or cable temperatures due to loose or faulty connections and to prevent equipment damage and fire.
- The Analytics and Reporting Tools shall be certified as part of an Energy Data Management System in accordance to the data validation requirements of ISO 50001 Section 4.6.1 (Monitoring, measurement and analysis).
- The Analytics and Reporting Tools shall be intelligent enough to make suggestions for harmonic mitigation equipment suitable to counteract any chronic excessive harmonics conditions that may be detected.

SN	Material Description
1	<p>Design, manufacture, supply, installing and testing of SCADA System for remote Control and Monitoring 33/11kV Sub-station including 33kV & 11KV RMU, LT [Monitoring], Network switch etc complete in all respects. SCADA System will have redundant server (Main + Backup server).</p> <p>SCADA, RTU & FRTU should be of same make to ensure seamless integration. SCADA should be Integrable to MePDCL / Integrated Command & Control Centre (ICCC) Shillong Smart City Ltd. through Application programming interface. SCADA vendor should have prior experience of Integrating the same.</p>

4.7.2 SCADA INTEGRATION

- PSS / RMU should have inbuilt Field Remote Terminal Unit and Fault Passage Indicator.
- FRTU and SCADA software shall be of same make for the ease of integration with MePDCL / ICCS SSCL SCADA System.
- The work for integrating the SCADA system as mentioned in section 27.1 above with existing/new SCADA system of MePDCL shall be in the scope of work of the Bidder

4.7.3 SCADA Protocol Support

Communication between the FRTU / RTU and SCADA system shall be on IEC 60870-5-104 Protocol.

No loss of data:

Redundant communication shall be provided between FRTU/RTU and SCADA Software. In case both primary and standby communication fails It shall be possible to backfill the Data from FRTU/RTU to SCADA when communication re-establish.

SCADA shall support the following industry standard protocols:

- IEC60870-5-101 and IEC 60870-5-104 Master and Slave
- DNP3 Level 4-Level 4 conformant Master and Slave serial and DNP3 Level 4 over IP,
- Modbus RTU Master, Modbus RTU Slave
- Open Modbus/TCP Client, Open Modbus/TCP Server
- ICMP and NTP
- SNMP

4.7.4 System Security and Access

The SCADA system shall provide a high level of inherent security. To this end the SCADA software shall provide security access down to data point level, and support individual Users, User Groups and a matrix of system capability and access to any level of the SCADA database. Communication Protocol between FRTU/RTU and SCADA Software shall support Security Authentication V2.

Full-function Rich & Web client interfaces shall require explicit administrative configuration to valid connection to the SCADA server. Client interfaces shall provide the ability to restrict access to sensitive system information based on user privilege. System Administrators shall have the ability to allow/restrict client access to specific system interfaces by IP Address, IP Address Range, and/or CIDR (Classless Inter-Domain Routing) notation.

POTENTIAL FREE SIGNALS
HT Panel (Fixed-Type VCB) - Iso01On, Iso01Off, Iso01 Earth Iso02On, Iso02Off, Iso02 Earth VCB On, VCB Off, VCB Trip on Fault, Line-Earth On, Line-Earth Off, Incoming Feeder Live, Gas-Pressure Low, FPI ON/OFF
Transformer - WTI Alarm, WTI Trip
LT Panel - Main ACB On, Main ACB Off, Feeder MCCB On, Feeder MCCB Off... all MCCBs
Others - Transformer Door Open, LR Switch in Local, LR Switch in Remote

DIGITAL SIGNALS (Modbus via RS-485 Port)
HT Side Multifunction Meter - kV, Amp, pf, Hz, kWh, kw, kvar, Kva
LT Side Multifunction Meter - Voltage, Amp, kVA, kW, kWh
COMMANDS (Capable of being executed from SCADA)
ISO01 ON, ISO01 OFF, ISO02 ON, ISO02 OFF, VCB ON, VCB OFF, MCCB ON,
MCCB OFF
Local/Remote Switch shall be provided to cut-off control from Remote in Local
Condition
Terminal Block arrangement to act as junction between hard-wired signals being received from HT/LT/Transformer compartment and wiring into the FRTU.
Isolation MCB, and associated aux. supply circuit for Field RTU unit.
LED Indication to indicate aux. supply availability for Field RTU

4.8 Guaranteed Technical Particulars (GTP) of CSS/PSS

Sample of GTP for CSS/PSS is given at para 13.1 (Annexure) Annexure-I: Guaranteed Technical Particulars (Bidders are required to provide details of the proposed products in their Bids in this format.

5 RING MAIN UNIT

5.1 General Specifications

The RMUs offered shall be compact, maintenance free, easy to install reliable to operate, safe and easy to operate and complete with all parts necessary for their effective and trouble-free operation. Such parts will be deemed to be within the scope of the supply irrespective of whether they are specifically indicated in the commercial order or not.

The objective of the RMUs is for extremely small construction width, compact, maintenance free, independent of climate, easy installation, operational reliability, Safe and easy to operate, minimum construction cost, minimum site work and minimum space requirement. For Outdoor RMU enclosure shall be of degree of protection IP 55 and degree of protection of the gas tank shall be IP 67. The main tank shall be stainless steel sheet with pressure relief arrangement and Type tested design.

The RMUs shall conform in all respects to high standards Of Engineering design, workmanship, and latest revisions of relevant standards at the time of offer.

5.2 Applicable Codes and Standards

The RMU, Switchboard (Switchgear), Load break isolators, Instrument Transformers and other associated accessories conform to the latest revisions and amendments thereof of the following standards:

Table 8: Applicable Codes and Standards for RMUs

SN	Standard Code	Description
1.	IEC 62271-200/IS 12729:1988	General requirement for Metal Enclosed Switchgear
2.	IEC62271-102/IS 9921	AC disconnectors (Load Break Isolators) and Earthing Switch.
3.	IEC 62271-100 / IEC 62271-200	Specification for alternating current circuit breakers
4.	IEC 62 271-1	Panel design, SF6/Vacuum Circuit Breakers
5.	IEC60044-1/IS2705:1992	Current Transformer
6.	IEC 60265/IS 9920:1981	High voltage switches
7.	IEC 60376	Filling of SF6 gas in RMU
8.	IEC 60273/IS :2099	Dimension of Indoor & Outdoor post insulators with voltage > 1000 Volts
9.	IEC 60529/IS 13947(Part-1)	Degree of protection provided by enclosures for low voltage switchgear and control gear.
10.	IS 3043-1987	Code of Practice for earthing
11.	IEC 60044-2	Instrument transformer Part 2: Voltage transformer
12.	IEC 60255	Electrical relays

5.3 Ring Main Unit Specification

SN	Material Description	Tentative locations for reference of the Bidders
1	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (4 Way Ring Main Unit). comprising 2 Nos. 11 KV, 630 A, 21 KA for 3 sec 2 Nos. Load break switches and 2 nos. 630 A VCB 21 KA for 3 sec as outgoing and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>Netaji Subash Chandra Bose Square, MePDCL (CDS Division Premises), Mi-Casa Hotel, BSNL Oakland Guest house, Ward's Lake, YWCA Junction (Camel's Back), Oxford Junction (Rhino Road), Police Point (Laitumkharah Road), Veronica Lane (opp. Habitat), Don Bosco Square, Social Welfare Office.</p>
2	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (4 Way Ring Main Unit). comprising 4 Nos. 11 KV, 630 A, 21 KA for 3 sec 4 nos. Load break switches interlocking. Suitable for manual & motorized operation. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>MePDCL CDS Office (Keating Road), Secretariat Area.</p>
3	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (4 Way Ring Main Unit). comprising 3 Nos. 11 KV, 630 A, 21 KA for 3 sec 3Nos. Load break switches and 1 no. 630 A VCB 21 KA for 3 sec as outgoing and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>Income Tax Quarters.</p>
4	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (5 Way Ring Main Unit). comprising 4 Nos. 11 KV, 630 A, 21 KA for 3 sec 4 Nos. Load break switches and 1 no. 630 A VCB</p>	<p>Secretariat Hill Road – 2 Nos.</p>

SN	Material Description	Tentative locations for reference of the Bidders
	<p>21 KA for 3 sec as outgoings and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	
5	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (5 Way Ring Main Unit). comprising 3 Nos. 11 KV, 630 A, 21 KA for 3 sec 3Nos. Load break switches and 2 nos. 630 A VCB 21 KA for 3 sec as outgoings and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>MePDCL Polo Division Premises, Hotel Orchid (opp. CM Bungalow), Beat House (Laitumkhrah Road).</p>
6	<p>Supply, installation, testing and commissioning of outdoor type RMU (6 Way Ring Main Unit). comprising 4 Nos. 11 KV, 630 A, 21 KA for 3 sec 4 Nos. Load break switches and 2 nos. 630 A VCB 21 KA for 3 sec as outgoings and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>Fire Brigade Ground, Laitumkhrah Market, Laitumkhrah Market, Grotto Church.</p>

SN	Material Description	Tentative locations for reference of the Bidders
7	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (5 Way Ring Main Unit). comprising 2 Nos. 11 KV, 630 A, 21 KA for 3 sec 2 Nos. Load break switches and 3 nos. 630 A VCB 21 KA for 3 sec as outgoing and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	Municipal Junction (Rhino Road), Garrison Ground
8	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (5 Way Ring Main Unit). comprising 5 nos. 630 A VCB 21 KA for 3 sec as outgoing and earth switch bus bars, interlocking. Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	Dhankheti Point
9	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (4 Way Ring Main Unit). comprising 4 nos. 630 A VCB 21 KA for 3 sec (2 Nos VCB as Incomer & 2 Nos VCB as Outgoing) Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement Functionality between two LBS Function of RMU via FRTU. Between Incomers LBS shall have a provision of mechanical interlocking through Castle Key.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	Secretariat Area

SN	Material Description	Tentative locations for reference of the Bidders
10	<p>Supply, Installation, Testing and Commissioning of outdoor type RMU (5 Way Ring Main Unit). comprising 5 nos. 630 A VCB 21 KA for 3 sec (3 Nos VCB as Incomer & 2 Nos VCB as Outgoing) Suitable for manual & motorized operation, with self-powered microprocessor based 3 ph. numerical relay and metering unit with CTs and PTs with MFM for each VCB feeder. FPI (Fault position Indication), bushing for 630A, arc proof cable cover complete with interlocking, FRTU and SCADA shall be of same make. RMU Manufacturer should have valid Type test for IAC AFLR 1 sec for both tank and cable box for a rating of 21kA RMU should have electrically interlocking arrangement functionality between two LBS Function of RMU via FRTU. Between Incomers LBS shall have a provision of mechanical interlocking through Castle Key.</p> <p>RMU Manufacturer should have valid TYPE TEST REPORTS.</p>	<p>Camel's Back Sub Station, Last stop, Polo Market, Raj Bhavan.</p>

The main tank shall be stainless steel sheet with a pressure relief arrangement as per type tested design of manufacturer.

The switchgear and busbar shall all be contained in a stainless-steel enclosure filled with SF6 at 0.3 bar relative pressure to ensure the insulation and breaking functions. Sealed for life, the enclosure shall meet the "sealed pressure system" criterion in accordance with the IEC 62271-1 standard.

Capacitor voltage dividers serving live-line cable indicators and all the indicators shall have to be visible in the front of the ring main unit

The RMU metal parts shall be made of painted with Pure Polyester based power paint with a paint shade in line with manufacturer's standard. As a standard the sheet steel shall be treated through 7-tank treatment process and shall be powder coated with thickness of 60-80 microns.

5.4 Minimum requirements of Ring Main Units

- Ring Main unit should have LBS /earth switch rated for M1(1000 O/C) and E3 (100 operations).
- Breaker should have 2000 mechanical/electrical operations and more than 30 short circuit operations, ensuring higher operational life.
- The disconnecter and earthing switch of the breaker function shall be provided at the cable side and earth switch should be rated for making duty. Type test reports on making capacity, short-time withstand current and peak short-circuit current shall be supplied. Earthing through breaker shall not be acceptable.
- Internal Arc Type Test Report for IAC AFLR 21 kA for 3 sec for both tank & cable box should have been for minimum 3 way / 3 Function RMU.
- In case of an internal arc, the exhaust should open downwards into the cable chamber, away from the operator standing front, lateral or rear, thus ensuring operator safety.
- FRTU and SCADA shall be of same make for the ease of integration with MePDCL / ICCS SSCL SCADA System.
- RMU should have Auto Transfer Source Functionality between two LBS Function of RMU via FRTU.
- Separate metering panel/enclosure should be provided for mounting FRTU, battery and battery charger along with related accessories. The canopy cover of the Ring main unit and Metering panel

door shall be separate and shall be lockable, to prevent tampering.

- All necessary operation of the RMU (switch operation, status monitoring etc) shall be through front only including access to the cable chamber. No side or rear access to the cable chamber shall be acceptable.
- CT shall be mounted on separate CT mounting plate, without putting pressure on the cable bushings of the RMU.
- Proper cable support provisions shall be provided for termination of the cable, in addition to the cable clamp provided along with the gland plate. Minimum termination height of around 600mm should be provided for terminating 11kV cables.
- Thermal sensors should be provided in the cable chamber of Ring main unit. All the sensors are to communicate sensor data concentrator through Zigbee, which shall further communicate with FRTU for remote SCADA monitoring through MODBUS RTU connection.
- Thermal sensor should have discrepancy alarm between phases and threshold alarms for individual phases. Humidity /climatic sensor should provide ambient temperature and ambient humidity signals.
- Manufacturer to declare the make of vacuum interrupter offered is same as used in type tests.
- The equipment offered in the tender should have been successfully type tested at NABL laboratories in India or equivalent international laboratories within 10 years from the date of offer submission.

5.5 Technical Particulars for Ring Main Unit & its Components

5.5.1 Load Break Isolators

Table 9: Technical Particulars for Load Break Isolators

SN	Technical Particular	Details
1.	Construction per phase a	SF6-Single Break
2.	Current Capacity	630A
3.	Making Capacity	50 KA (peak)
4.	Breaking capacity normal load current	630A
5.	Short time rating	21 KA for 3 second
6.	Short circuit current making capacity	50 KA
7.	Impulse withstands voltage to earth between poles	75 kV peak
8.	Power frequency withstand voltage to earth and between poles	28kV RMS for 1 min
9.	Electrical Class of Operation	E3
10.	Auxiliary Contacts	1 NO + 1 NC wired to terminal block

SN	Technical Particular	Details
11.	Operating Mechanism for close / open	Electrically operated with motor mechanism
12.	Manual operation of LBS with/without removal of motor shall be possible	Possible with/ without removal of motor
13.	Minimum number of operations at rated current as per IEC 60265	To be guaranteed by firm along with test certificate
14.	Minimum number of operations at fault current as per IEC 60265	Same as above
15.	Spring Charge Motor	D.C. Motor 24 volts
16.	Re-chargeable Battery Pack for Motor	24 volt D.C.
17.	Charger for Battery Pack	A.C.240V; 50Hz. of suitable Amp. Capacity.

5.5.2 Parameters for Switchgear of DT and LBS

Table 10: Parameters for Switchgear of DT and LBS

SN	Parameter	Details
1.	Type	Metal Enclosed
2.	No. of Phases	3
3.	No. of Poles	3
4.	Rated Voltage	12 kV
5.	Operating Voltage	11 kV (+10% to -20%)
6.	Rated lightning impulse withstand voltage	75 KV
7.	Rated power frequency withstand voltage	28 kV
8.	Insulating gas	SF6
9.	Rated filling level for insulation	0.35 bar/As Per relevant IS/IEC Code
10.	Maximum Permissible site altitude at the above gas pressures (The operating pressure has to be adjusted for greater altitudes)	1500 Mtrs
11.	Rated short time current	21 kA

SN	Parameter	Details
12.	Rated short time	3s
13.	Rated peak withstands current	50 KA
14.	Operating mechanism	Circuit breaker with spring assisted anti reflex mechanism.
15.	Rated current (Bus)	630A
16.	Rated current (Breaker)	630A
17.	Circuit Breaker interrupter	VCB
18.	Rated frequency	50 Hz
19.	Rated operating sequence	O-0.3sec- CO -3min-CO

5.5.3 Principal Features

SN	Feature	Remarks
1.	Circuit Label	Yes
2.	Mimic Diagram	Yes
3.	Supply voltage indication	Yes
4.	Current Transformer	Yes
5.	Self-Powered Microprocessor based communicable IDMT Relay (3OL)	Yes
6.	Interlock for non-operation of line side earthing when the line side isolator is ON.	Yes
7.	Interlock for non-operation of the earthing when the breaker is in service position and is ON. (With disconnecter in ON condition)	Yes
8.	Local / Remote Switch (In case of motorized RMUs only)	Yes
9.	Breaker ON / OFF indication	Yes
10.	Fault Tripping indication	Yes
11.	Bus bar end caps	Yes
12.	The SF6 gas pressure gauge indicator and filling valve.	Yes

SN	Feature	Remarks
13.	The spring assisted mechanism with operating handle for ON/OFF.	Yes
14.	The earth positions with arrangement for padlocking in each position and independent manual operation with mechanically operated indicator are provided	Yes
15.	Status signals to SCADA to be wired to marshaling terminal block (2NO+2NC)	Yes
16.	LBS close /open (potential free contacts)	Yes
17.	LBS& CB Earth Switch close /open (potential free contacts)	Yes
18.	Battery charger Fails (potential free contacts)	Yes
19.	CB close /open (potential free contacts)	Yes
20.	Protection relay operated (potential free contacts)	Yes
21.	FPI operated (potential free contacts)	Yes
22.	SF6 gas pressure Low (potential free contacts)	Yes
23.	Commands from SCADA to be wired to marshaling terminal block	LBS close/ open, FPI reset etc. (For other details please see Automation Philosophy)

5.5.4 Earthing switch for LBS & CB (11 KV Line side Isolation and DT)

SN	Parameter	Details
1.	Rated short time & current	20 kA, 3 Sec
2.	Rated peak withstands current	50 kA
3.	Interlocking facility	Between 11 KV Line side isolator 'ON" & Earthing. Between 11 KV DT side breaker on close condition & Earthing. Between breaker & disconnector on breaker function
4.	Auxiliary contacts	NO + 2 NC wired to terminal block

5.5.5 11 kV Bus Bar

SN	Parameter	Details
1.	Type of Material	Copper
2.	Current Carrying Capacity	630A
3.	Short time rating current for 3 Sec.	20 kA
4.	Insulation of Bus Bar	SF6
5.	Bus Bar Connections	Anti-oxide grease

5.6 Guaranteed Technical Particulars (GTP) of RMU

Sample of GTP for RMU is given at para Annexure-I: Guaranteed Technical Particulars (0 (Annexure). Bidders are required to provide details of the proposed products in their Bids in this format.

6 FIELD REMOTE TERMINAL UNIT [For PSS (11 kV / 415 V) & RMU]

6.1 TECHNICAL REQUIREMENTS OF FRTU

6.1.1 General

The Feeder Remote Terminal Unit (FRTU) shall be installed in Ring Main Units (RMUs). FRTU shall be used for control of switching devices such as breaker, isolator inside RMU.

6.2 Design Standards

The FRTUs shall be designed in accordance with applicable International Electro-technical Commission (IEC), Institute of Electrical and Electronics Engineer (IEEE), American National Standards Institute (ANSI), and National Equipment Manufacturers association (NEMA) standards, unless otherwise specified in this technical specification. In all cases the provisions of the latest edition or revision of the applicable standards in effect shall apply.

6.3 FRTU Functions

As a minimum, the FRTU shall be capable of performing the following functions:

- FRTU should be a DIN rail mount. FRTU should have a Head end unit to communicate with upstream control center and to downstream DI/DO modules (DI-DO module is Acquires Hardwired Digital Input, hardwired Digital Output and Analog Input from MFT or alternatively through transducer- less modules).
- Use of IEC 60870-5-101/104 protocol to communicate with the Master station(s). Use of MODBUS protocol over RS485 interface to communicate with MFTs. FRTU shall support IEC61850 protocol to communicate with Numerical relays.
- Have required number of communication ports for simultaneous communication with Master station(s), MFTs and FRTU configuration & maintenance tool. Ethernet 3 Nos and RS485 1 No ports to be provided as a minimum.
- FRTU shall have the capability of automatic start-up and initialization following restoration of power

after an outage without need of manual intervention. All restarts shall be reported to the connected master stations.

- Remote database downloading of FRTU from master station from SCADA control center.
- As the SCADA system will use public domain such GPRS/CDMA etc., therefore it mandatory to guard the data/ equipment from intrusion/damage/breach of security & shall have adequate cyber security features. the FRTU shall be designed to be compliant with NERC and IEC62351 requirements. The FRTU shall support secure access based on RBAC, with the possibility to configure the roles.
- An inbuilt wifi communication modem shall be offered in FRTU for local access via hand held devices (Tablet / smart phone / etc.)
- FRTU shall have capability of minimum 450,000 local events storage.
- FRTU shall have one port (USB) for connecting the portable configuration and maintenance tool for FRTU.
- Configuration - Access to the FRTU by configuration tool shall be possible only through secured connection: HTTPS for Webserver and SSH for console and configuration tool.
- Control Output (16 DO capabilities in Acquisition module) - The FRTU shall provide the capability for a master station to select and change the state of digital output points. These control outputs shall be used to control power system devices such as Circuit breakers, isolator, reset, relay disable/enable and other two-state devices, which shall be supported by the FRTU.
- The internal FRTU time base shall have a stability of 10 ppm. The FRTU shall be synchronized through synchronization message from master station at every 5 minutes (configurable from 5 minutes to 60 minutes) over IEC 60870-5-104/101/NTP/SNTP.
- Input DC Power Supply - The FRTU will be powered from a 12Vdc / 24Vdc / 48 V DC power supply system. The FRTU shall not place additional ground on the input power source. The characteristics of the input DC power supply shall be Nominal voltage of 12Vdc / 24Vdc / 48 Vdc with variation between +20% & -15% The FRTU shall have adequate protection against reversed polarity, over current and under voltage conditions, to prevent the RTU internal logic from being damaged and becoming unstable causing mal-operation. Voltage of DC Supply should be monitored continuously by FRTU as Measurement/Analog value using DC Transducer with 4-20mA Output and transmitted to SCADA.
- Diagnostic Software - Diagnostic Software shall be provided to continuously monitor operation of the FRTU and report FRTU hardware errors to the connected master stations. The software shall check for memory, processor, and input/output ports errors and failures of other functional areas defined in the specification of the FRTU.
- Environmental Requirements - The FRTU will be installed in inside RMU Panel or in open environment with no temperature or humidity control. The FRTUs shall be capable of operating in ambient temperature from 0 to +55 degree C with rate of temperature change of 20 degree C/hour and relative humidity less than 95%, non-condensing. FRTUs to be installed in the hilly region with the history of snowfall, the same the lower ambient temperature limit shall be -5 degree C.
- DI-DO Acquisition module details:
 - Analog Inputs (4AI capability in Acquisition module):

The real time values like, Active power, Reactive Power, Apparent power three phase Current & Voltage and frequency, power factor & accumulated values of import /export energy values will be acquired FRTU from the following in the given manner:

 - a) Multi-Function Transducers installed in RMU/DTs
 - b) RTU shall also take 4-20 mA, 0-20mA, 0- -10mA, 0-+10mA, 0-5V etc. as analog inputs to acquire DC power supply voltage etc.

- o Status input (32 DI capability in Acquisition module)
 - a) FRTU shall be capable of accepting isolated dry (potential free) contact status inputs. The FRTU shall provide necessary sensing voltage, current, optical isolation and de-bounce filtering independently for each status input
 - b) FRTU shall support Self-Healing Grid feature, so that it shall support Fault location, Isolation and supply restoration without any manual and SCADA intervention.
 - c) This feature will enable the RMU to supply 11KV supply without any manual intervention.
 - d) FRTU shall support peer to peer communication.
 - e) FRTU manufacturer shall submit the performance certificate from utility.

6.4 Salient Features

- Online Temperature Monitoring in PSS shall be provided with following technical requirements:
- RMU, Transformer & LT section shall have temperature measurement sensors in cable chamber to monitor abnormality of cable termination
- The wireless temperature sensors installed shall have, communication with FRTU
- The FRTU shall allow 2 configurable thresholds (pre-alarm and alarm) which shall be monitored locally via web page access and remotely at Scada
- The system shall be online to immediately provide an abnormal temperature alarm (with identification/location of the abnormal temperature) to the operator
- Wireless sensors shall be self-powered
- Life of the sensors shall be same as that of RMU
- This will, enhance the capability to identify the deteriorating and health of the switchgear in very early stages, aiming to provide online condition monitoring to detect electrical devices impending failures and avoid unscheduled downtime. It is the next step to move from preventive maintenance to predictive maintenance.

7 RTU AND ASSOCIATED HARDWARE [For Sub-Station (22 / 11 kV & 33/ 11 KV)]

7.1 General Requirement

The RTUs shall be designed in accordance with applicable International Electro-technical Commission (IEC), Institute of Electrical and Electronics Engineer (IEEE), American National Standards Institute (ANSI), and National Equipment Manufacturers association (NEMA) standards, unless otherwise specified in this technical specification. In all cases the provisions of the latest edition or revision of the applicable standards in effect shall apply.

7.2 RTU Functions

As a minimum, the RTUs shall be capable of performing the following functions:

- Collecting and processing the digital status inputs, analog inputs, accumulated values and transmitting to master station(s)
- Receiving and processing digital & analog control commands from the master station(s)

- Accepting polling messages from at least three master station(s) simultaneously using separate logical databases for each master station.
- Communication simultaneously on all Communication ports (as per cl. 1.3) and using multiple concurrent protocols, including the IEC 60870-5-101, 60870-5-104 & MODBUS/103 protocol.
- Data transmission rates from 300 to 9600 baud for serial ports (for both IEC 60870-5-101 & MODBUS/103) and 10/100 Mbps for TCP/IP Ethernet ports.
- RTU shall be compatible with protocol IEC 61850-Ed2 for communication with IEDs. / Numerical Relays
- RTU shall have the capability of automatic start-up and initialization following restoration of power after an outage without need of manual intervention. All restarts shall be reported to the connected master station(s).
- RTU shall support time synchronization through messages received from master station using IEC 60870-5-101 protocol.
- RTU shall support downloading of RTU database from the master station for RTUs working on IEC 60870-5-104 protocol.
- RTU shall support SOE (Sequence of events) feature
- Acting as a data concentrator for acquiring data from Slave RTUs and exercising supervisory control on slave RTUs using IEC 60870-5-101 and IEC 60870-5-104 protocol.
- RTU to be equipped with Cyber Security with the following:
 - Users Authorization and authentication (Role Based Access Control)
 - The RTU shall be Hardened to resist to Cyber Security Threats: the specific CS measures are to be described.
 - It shall pass the “Achilles” Test Level 1, indication of its robustness
 - CS Vulnerabilities are to be managed by a CERT and Customer is to be informed in case of Vulnerability Identification
 - Supplier is to offer Cyber Security services such as Risk Analysis, CS Training, CS Patch management, Disaster recovery.
 - RTU firmware is to have a “Firmware signature”, identifying the Supplier.
- RTU shall be IEC 61850 Ed1 Level A KEMA certified.

7.3 Communication ports

The RTUs shall have communication ports as follows:

- Two Ethernet ports for connectivity to Master Station (Remote) on IEC 60870-5-104
- Two Ethernet ports for connectivity to IEDs/Numerical Relays on IEC 61850.
- One port for the RTU maintenance and configuration terminal
- The RTU shall use the IEC 61850 protocol for communication with IEDs/Numerical Relays over Sub-station LAN. The RTU shall act as a Client and collect data from the IEDs/Numerical Relays).
- The RTU shall store the data acquired from the MFTs & IEDs/Numerical Relays in its database and do processing like change detection / deadband processing on the data for optimizing its transmission to the Master Station (SCADA Control Centre)

7.4 Communication protocol

- The Contractor shall provide a communication protocol for communicating with SCADA master stations using the IEC 60870-5-101 and IEC 60870-5-104 communication protocol standard
- The RTU shall process the various messages/commands for communication to the Master station using the following priority:
 - Control command
 - Status data by exception
 - Analog data by exception
 - Analog data periodic
 - Status data integrity scan

7.5 Technical Parameters of RTUs

Table 11: Technical Parameters of RTUs

SN	Description	Value	Comments
1	Data Transmission rate	300 to 9600 bps for serial port & 10/100 Mbps for Ethernet port	Configurable
2	Communication Port	Minimum 8 Ports	Two Ethernet ports for connectivity Master Station IEC 60870-5-104 Two Ethernet ports for connectivity IEDs/Numerical Relays on IEC 61850. Two RS232 ports for communication with Two master stations on IEC 60870-5-101 One port for the RTU maintenance and configuration terminal. Two ports Communication with Local Data Monitoring System (LDMS) Required number (minimum two) of RS 485 ports for polling multi-function transducers MODBUS/ 60870-5- 103 protocol in multi- drop (party mode. Maximum 8 Numbers of MFTs connected to a single port in multi-drop mode.
3	Communication protocol with Master stations	IEC 60870-5-101/ 104	
4	Communication Protocol with LDMS	IEC 60870-5-104	
5	Communication Protocol with MFTs	MODBUS / IEC 60870-5-103	
6	Communication Protocol with IEDs	IEC 61850	

SN	Description	Value	Comments
	/ Numerical Relays		
7	Status data transfer to Master station	By Exception	
8	Analog data transfer to Master station	Normally Periodic For major change – by exception	
9	RTU shall be able to capture contact operations	of 20 ms or more duration.	
10	SOE buffer size	at least 1000 events for each master and LDMS	
11	Time stamping	1 ms	
12	Supporting Control of Devices	Two state & OLTC capacitors	
13	Downloading of RTU database from master station	Supported	
14	RTU internal clock stability	At least 2 ppm	
15	Nominal Power supply voltage	48V DC	

8 Moulded-Case Circuit Breakers (MCCB)

8.1 General

- MCCBs shall comply with standards IS/IEC 60947-1 & 2.
- MCCB shall have a rated operational voltage of 415V, insulation voltage of 690 V (AC 50/60 Hz) & impulse voltage of not less than 8kV.
- MCCBs shall be current limiting type preferably having an encapsulated double break design having two fixed contacts, one moving contact and two arc chutes per pole. The design is required to minimize the effects of short circuit currents i.e. limit the let through energy and improve the life of cables.
- MCCB shall not have any line load bias
- MCCB shall comply with the environmental directives like RoHS and WEEE
- All MCCBs upto 630A in main LT panel shall be plug-in type for ease of maintenance

8.2 Performance

- The MCCBs shall have a rated service breaking capacity (Ics) equal to the ultimate breaking capacity (Icu) at 415V equal to 36kA. MCCB's Manufactures can optimize breaking capacity of outgoing MCCB's by using cascading technique.
- For maximum safety, the power contacts shall be insulated in an enclosure made of a thermosetting material from other functions such as the operating mechanism, the case, the trip unit and auxiliaries (ON/OFF/Trip Contact, Shunt, Under Voltage etc.).
- MCCBs shall be designed to prevent access to live parts when the cover is removed, means main current path of the circuit breaker should be isolated from auxiliary section i.e. MCCB shall offer class – II front face as per IEC standards 61140 and 60664-1
- The electrical life of MCCBs shall be 8,000 operations up to 250A & 4,000 operations up to 630A
- MCCBs shall have cross bolted type termination where bus bars or cable lugs can be terminated by crossing the bolt between the lugs/bus bars and MCCB connections, to enhance safety and reliability of the terminations. In case spreaders / rear connectors are used in between MCCB and bus bar/lugs then the spreaders shall be cross bolted with the MCCB connectors.
- The status of MCCB need to be communicated to SCADA

9 Air circuit breaker (ACB)

9.1 General

- ACB shall comply with standards IS/IEC 60947-1 & 2.
- ACB shall have a rated operational voltage of 415V AC, rated insulation voltage of 1000 volts AC, rated impulse voltage of 12kV.
- ACB shall be of 3pole or 4pole (as per BOQ), air break, molded case design for longer life along with less maintenance requirement
- ACB shall have a Ready to close mechanism preferably having a ready to close mechanical indication on front of ACB. All Fixed Manual ACBs ready to close indication contact which shall be used to give a single indication via indicating lamps on panel.
- ACB shall comply with the environmental directives like RoHS and WEEE.

9.2 Performance

- ACB shall have the breaking performance $I_{cs} = I_{cu} = I_{cw} (1\text{sec}) = 50\text{kA}$
- ACB shall have minimum Mechanical life of 20,000 operations
- The operating mechanism of ACB shall be of the Open/Closed/Open stored-energy spring type. The closing time shall be less than or equal to 70ms, and of fast opening type with break time of breaker should be <30ms to ensure higher life of distribution cables.
- The racking handle shall be stored on the air circuit breaker in such a manner as to be accessible without defeating the door interlocking.

9.3 Protections

- Air circuit breaker shall be provided with micro-processor release, which should be self-powered type without the need of any auxiliary power supply during normal operation of the breaker.

- The circuit breaker control unit shall measure the true r.m.s value of the current
- Circuit breaker trip unit shall have a display for measurement of current, voltage and energy. It shall be possible to view last 10 trip cause on trip unit.
- All trip units provided shall have thermal memory as standard
- All 4 Pole ACBs shall have fully rated neutral equal to rating of the breaker & shall be protected against over-load faults with provisions for settings neutral unprotected, neutral protection at $0.5I_n$ and neutral protection at $1.0I_n$ to ensure precise neutral protection.
- All trip units shall be EMC/EMI tested.

10 LV Feeder Pillar

10.1 General Requirement

Design, Engineering, Manufacture, shop testing, inspection, painting, packing, and supply of Feeder Pillar panels complete with all accessories for efficient and trouble-free operation of the electric distribution network for power utilities. The equipment shall conform in all respects to high standards of Engineering design and workmanship and shall be capable of performing in a manner acceptable to user. The general requirements from the installation are low electrical losses, weather resistance, easy installation & connections, safe & touch proof design, easy sectionalizing & maintenance & maximum service life.

10.2 Specific Requirement

The feeder pillar shall be Compact in size with complete with bus bars, wiring, cabling of proper ratings (not less than 1.5 times the rating of respective switchgears, control gear etc.) for inter connection between switch gear, control gear, metering, safety relays, indicators etc.

The feeder pillar shall have proper arrangement for termination of all incoming and out goings cables. All the bus bars shall be supported on epoxy supports and shall be insulated with colour coded heat shrinkable sleeves. Feeder pillar shall be as per the space available at site. It shall have earthing bolts at both sides interconnected with 50x5 mm Al earthing bus along the width of feeder pillar.

The feeder pillar shall have space and proper arrangements for installation of incoming and outgoing MCCBs with R, Y, B LED type indicating lamps, Smart Energy Meter for Street Light pole.

11 Specifications of Feeder Pillar Panels

11.1 Type:1

Feeder Pillar panels suitable for AC 440 V, 50 HZ supply, fabricated with 14-gauge galvanised steel sheet duly pre-treated and pure polyester thick powder coated 80-micron thickness using Siemens grey colour shade no. RAL-7032 / any other colour if required by client. The feeder pillar shall be double door in cubical formation, compartmentalized in form with front open able doors. The door shall be provided with concealed hinges and with brazing wherever required to avoid deformation and shall be earthed. All the door shall have heavy duty door locks, and shall be sealed with neoprene gaskets. The feeder pillar shall be IP 55, outdoor type weather, dust and vermin proof having canopy type tapered roof self-standing type as per approved GA diagram. Location for Timer Switch for Street light control inside the panel.

The feeder pillar shall be Compact in size with complete with bus bars, wiring, cabling of proper ratings (not less than 1.5 times the rating of respective switchgears, control gear etc.) for inter connection between switch gear, control gear, metering, safety relays, indicators etc. as per the approved single line diagram. The feeder pillar shall have proper arrangement for termination of all incoming and out goings cables. All the bus bars shall be supported on epoxy supports and shall be insulated with colour coded heat shrinkable

sleeves. Feeder pillar shall be as per the space available at site. It shall have earthing bolts at both sides inter connected with 50x5 mm Al earthing bus along the width of feeder pillar. Note: -The GA drawing for panel should be approved by consultant / engineer in charge before fabrication. The feeder pillar shall have space and proper arrangements for installation of incoming and outgoing MCCBs with R,Y,B LED type indicating lamp. With facility for smart energy meters and GSM Dual sim Modem.

MCCBs etc. complete with interconnection provisions with providing wiring and bus bars with required hardware, sleeves, ferrules, supporters, locks etc. Panel shall have proper space and arrangements for termination of incomer loop in loop out cables, outgoing service cables, with proper offsets in bus bars for cable terminations. Feeder Pillar shall be comprising of following items:

Rating of incomer MCCB TPN 150 A, 35KA (Adjustable thermal O/L with $I_{cs} = 100\% I_{cu}$).

Outgoing MCB , 10KA, of 32A SP -30 nos and MCB , 10KA, of 63A SP -6 nos,

11.2 Type:2

Feeder Pillar panels suitable for AC 440 V , 50 HZ supply, fabricated with 14-gauge galvanised steel sheet duly pre-treated and pure polyester thick powder coated 80-micron thickness using Siemens grey colour shade no. RAL-7032 / any other colour if required by client. The feeder pillar shall be double door in cubical formation, compartmentalized in form with front open able doors. The door shall be provided with concealed hinges and with brazing wherever required to avoid deformation and shall be earthed. All the door shall have heavy duty door locks, and shall be sealed with neoprene gaskets. The feeder pillar shall be IP 55, outdoor type weather, dust and vermin proof having canopy type tapered roof self-standing type as per approved GA diagram. Location for Timer Switch for Street light control inside the panel.

The feeder pillar shall be Compact in size with complete with bus bars, wiring, cabling of proper ratings (not less than 1.5 times the rating of respective switchgears, control gear etc.) for inter connection between switch gear, control gear, metering, safety relays, indicators etc. as per the approved single line diagram. The feeder pillar shall have proper arrangement for termination of all incoming and out goings cables. All the bus bars shall be supported on epoxy supports and shall be insulated with colour coded heat shrinkable sleeves. Feeder pillar shall be as per the space available at site. It shall have earthing bolts at both sides inter connected with 50x5 mm Al earthing bus along the width of feeder pillar. Note:-The GA drawing for panel should be approved by consultant / engineer in charge before fabrication. The feeder pillar shall have space and proper arrangements for installation of incoming and outgoing MCCBs with R,Y,B LED type indicating lamp. With facility for smart energy meters and GSM Dual sim Modem.

MCCBs etc. complete with interconnection provisions with providing wiring and bus bars with required hardware, sleeves, ferrules, supporters, locks etc. Panel shall have proper space and arrangements for termination of incomer loop in loop out cables, outgoing service cables, with proper offsets in bus bars for cable terminations. Feeder Pillar shall be comprising of following items:

Rating of incomer MCCB TPN 100 A, 35KA (Adjustable thermal O/L with $I_{cs} = 100\% I_{cu}$).

Outgoing MCB, 10KA, of 32A SP - 18 nos. and MCB , 10KA, of 63A SP -6 nos.

11.3 Type:3

Feeder Pillar panels suitable for AC 440 V , 50 HZ supply, fabricated with 14-gauge galvanised steel sheet duly pre-treated and pure polyester thick powder coated 80 micron thickness using Siemens grey colour shade no. RAL-7032 / any other colour if required by client. The feeder pillar shall be double door in cubical formation, compartmentalized in form with front open able doors. The door shall be provided with concealed hinges and with brazing wherever required to avoid deformation and shall be earthed. All the door shall have heavy duty door locks, and shall be sealed with neoprene gaskets. The feeder pillar shall be IP 55, outdoor type weather, dust and vermin proof having canopy type tapered roof self-standing type as per approved GA diagram. Location for Timer Switch for Street light control inside the panel.

The feeder pillar shall be Compact in size with complete with bus bars, wiring, cabling of proper ratings (not

less than 1.5 times the rating of respective switchgears, control gear etc.) for inter connection between switch gear, control gear, metering, safety relays, indicators etc. as per the approved single line diagram. The feeder pillar shall have proper arrangement for termination of all incoming and out goings cables. All the bus bars shall be supported on epoxy supports and shall be insulated with colour coded heat shrinkable sleeves. Feeder pillar shall be as per the space available at site. It shall have earthing bolts at both sides inter connected with 50x5 mm Al earthing bus along the width of feeder pillar. Note:-The GA drawing for panel should be approved by consultant / engineer in charge before fabrication. The feeder pillar shall have space and proper arrangements for installation of incoming and outgoing MCCBs with R,Y,B LED type indicating lamp. With facility for smart energy meters and GSM Dual sim Modem.

MCCBs etc. complete with interconnection provisions with providing wiring and bus bars with required hardware, sleeves, ferrules, supporters, locks etc. Panel shall have proper space and arrangements for termination of incomer loop in loop out cables, outgoing service cables, with proper offsets in bus bars for cable terminations. Feeder Pillar shall be comprising of following items:

Rating of incomer MCCB TPN 63 A, 35KA (Adjustable thermal O/L with $I_{cs} = 100\% I_{cu}$).

Outgoing MCB , 10KA, of 32A SP -18 nos.

11.4 Guaranteed Technical Particulars (GTP) of Feeder Pillars

Table 12: Guaranteed Technical Particulars of Feeder Pillars

Guaranteed Technical Particulars (GTP) Feeder Pillar		
SN	Description	Details
A	General	
1	Name of Manufacturer	As per list of manufacturers
2	Product Designation	Feeder Pillar
3	Product Details	Feeder Pillar panels suitable for AC 440 V
4	Configuration	Configuration as per BOQ
5	Incoming Circuit	Configuration as per BOQ
6	Outgoing Circuit	as per BOQ
7	Application of product	Outdoor
8	Humidity	90% maximum
B	System Information	
1	Rated Voltage	415V \pm10% Between Ph-Ph
2	No. of phases	3 No's
3	Frequency	50
C	Pillar Construction	
9	Painting	14-gauge galvanized steel sheet duly pre-treated and pure polyester thick powder coated 80-micron thickness.
10	Color	Light grey shade RAL 7035
11	Degree of protection	IP55
12	Panel Dimensions (H x W x D)	AS approved

Bidders are required to provide details of the proposed products in their Bids in the format prescribed at para 13.3.

11.5 Earthing

- All metallic components are earthed to a common earthing point and transformer neutral point to be separate by chemical earthing.
- It is terminated by an adequate terminal intended for connection to the earth system of the installation, by way of flexible jumpers/strips & Lug arrangement.
- The continuity of the earth system is ensured taking in account the thermal & mechanical stresses caused by the current it may have to carry.
- The components to be connected to the earth system include:
 - The enclosure of Compact Package Sub-station.

- The enclosure of High voltage switchgear and control gear from the terminal provided for the purpose.
- The metal screen & the high voltage cable earth conductor.
- The transformer tank or metal frame, of transformer.
- The frame or enclosure of low voltage switchgear.
- The neutral point of transformer.
- LT Feeder pillar panel.
- There is an arrangement for internal lighting activated by associated switch for HV, Transformer & LV compartments separately.

12 APPROVED MAKES

12.1 Compact Packaged Sub-station (CSS)

ABB / L&T / Siemens /Schneider Electric / Voltamp

(Note: In the CSS out of 4 Major Components (CSS, RMU, FRTU/SCADA, Transformer and LT Switchgear) 3 Nos. of Components should be of same make)

12.2 Ring Main Unit (RMU)

ABB/ L&T /Siemens /Schneider Electric / Voltamp

12.3 Dry type transformer in CSS

ABB/ Raychem /Siemens /Schneider Electric / Voltamp

12.4 LT switchgear

ABB / Legrand / L&T / Siemens / Schneider Electric

12.5 HT and LT cables

CCI / Finolex / Havells / KEI / RPG / Ravin / Universal & Other ISI marked makes (approved by MePDCL) fulfilling the specifications with prior approval of engineer.

13 Annexure

13.1 Annexure-I: Guaranteed Technical Particulars (GTP) (Sample) for CSS/PSS

SN	Description	Particulars
M.V SECTION		
1	SWITCHGEAR ASSEMBLY	
1.1	Make	
1.2	Type	
1.3	Reference Standard	
1.4	Voltage (Normal/Max.) kV	
1.5	Phase (Nos.)	
1.6	Frequency (Hz)	
1.7	Short Circuit Rating	
a)	Breaking Symmetrical (kA)	
b)	Breaking Asymmetrical (kA)	
c)	Short time for 1 Sec.	

SN	Description	Particulars
d)	Short time for 3 sec.	
1.8	Insulation Level	
a)	Impulse Withstand (kV peak)	
b)	1 minute 50 Hz. Voltage Withstand (kV rms)	
1.9	Metal Clad Construction	Yes/ No
1.10	Degree of protection:	
1.11	Switchgear completely wire and tested at factory:	Yes/ No
2	CONSTRUCTION	
2.1	Overall Dimensions	
a.	Breaker	
	i) Length (mm)	
	ii) Breadth (mm)	
	iii) Height (mm)	
b.	Isolator	
	1)Length (mm)	
	2) breadth (mm)	
	3) Height (mm)	
c.	Total Extensible RMU	
	1) Length (mm)	
	2) Breadth (mm)	
	3) Height (mm)	
2.2	Weight	
	a) Breaker (kg)	
	b) Isolator (kg)	
	c) Complete RMU (kg)	
3	Bus Bar	
3.1	Make	
3.2	Material & Grade	

SN	Description	Particulars
3.3	Reference Standard	
3.4	a) Cross Sectional area (m m ²)	
	b) Size (m m ²)	
3.5	Continuous Current	
a)	Standard	
b)	At site conditions and within cubicle	
3.6	Maximum temperature rise over ambient (c)	
3.7.	Short time current for 3 Sec. (KA rms)	
3.8	Minimum clearance from bare bus bar connection	
a)	Phase to phase (mm)	
b)	Phase to earth (mm)	
3.9	Bus Bar provided with	
a)	Insulation Sleeve	
b)	Phase barriers	
c)	Cast Resin shrouds for joints	
3.10	Bus bar connection	
a)	Silver Plated	
b)	Made with anti- oxide grease	
3.11	Bus bar support spacing (mm)	
3.12	Bus support insulators	
a)	Make	
b)	Type	
c)	Reference Standard	
d)	Voltage Class (kV)	
e)	Minimum Creepage distance (mm)	
f)	Cantilever strength Kg/mm ²	
g)	Net Weight (kG)	
4	CIRCUIT BREAKER	

SN	Description	Particulars
4.1.	Make	
4.2.	Type	
4.3.	Reference Standard	
4.4.	Rated Voltage	
4.5	Rated Frequency	
4.6	No. of Poles	
4.7	Rated Current	
a)	Normal (Standard) Amps	
b)	De-rated (Site) Amps	
4.8	Maximum temperature rise over ambient °C	
4.9	Rated operating Duty	
4.10	Rupturing capacity at rated voltage (MVA)	
4.11	Breaking capacity at rated voltage & operating duty	
a)	Symmetrical (kA rms)	
b)	Asymmetrical (kA rms)	
4.12	Rated making Current (kA peak)	
4.13	a) Short time current for 1 sec. (kA rms)	
	b) Short time current for 3 Sec. (kA rms)	
4.14	Transient Recovery Voltage	
a)	Rate of rise (kV/ms)	
b)	Peak Voltage (kV)	
4.15	Insulation Level	
a)	Impulse voltage withstand on 1/50 full wave	
b)	1 minute 50 Hz. Voltage withstand	
4.16	Opening time maximum No load condition (ms)	
4.17	Opening and closing time under loss condition (ms)	
4.18	At 100% Breaking capacity	
a)	Opening time-Max. (ms)	

SN	Description	Particulars
b)	Arcing time-Max (ms)	
c)	Total break time (ms)	
4.19	At 60% breaking capacity	
a)	Opening time-Max. (ms)	
b)	Arcing time-Max. (ms)	
c)	Total break time (ms)	
4.20	At 30% breaking capacity (ms)	
a)	Opening time-Max. (ms)	
b)	Arcing time-Max. (ms)	
c)	Total break time (ms)	
4.21	At 10% breaking capacity (ms)	
a)	Opening time-Max. (ms)	
b)	Arcing time-Max. (ms)	
c)	Total break time	
4.22 a)	Make time (Max) (ms)	
b)	Total closing time (ms)	
4.23	Number of breaks per pole	
4.24	Total length of breaks per pole (mm)	
4.25	Total length of contact travel (mm)	
4.26	Speed of break (100% short circuit current)	
4.27	Rate of contact travel	
a)	At tripping M/sec.	
b)	At closing M/sec.	
4.28	No. of breaker operations permissible without requiring inspection, replacement of contacts and other main parts.	
a)	At 100% rated current	
b)	At 100% rated breaking current	
4.29	Type of contacts	
a)	Main	

SN	Description	Particulars
b)	Arcing	
4.30	Material of contact	
a)	Main	
b)	Arcing	
c)	Whether contacts silver plated	
d)	Thickness of silver plating	
4.31	Contact pressure at No load (Kg)	
4.32	Type of arc control device provided	
4.33	Operating mechanism-closing	
a)	Type	
b)	No. of breaker operations stored	
c)	Trip free or fixed trip	
d)	Anti-pumping features provided	
e)	Earthing for operating mechanism and metal parts furnished	
f)	Earth terminal size and material	
4.34	Operating mechanism-tripping	
a)	Type	
b)	No. of breaker operations stored	
c)	Trip free or fixed trip (V)	
d)	Anti-pumping features provided (%)	
e)	Earthing for operating mechanism and metal parts furnished	
f)	Earth terminal size and material	
4.35	a) Spring Charging mechanism	
	b) Make	
	c) Type	
	d) Size	
	e) rating	
4.36	Breaker suitable for capacity switching Operating duty	

SN	Description	Particulars
	Max. rating of capacitor bank that can be safely controlled	
4.37	Tripping Coil	
a)	Voltage	
b)	Permissible voltage variation (%)	
c)	Tripping Current at rated Voltage (A)	
d)	Power at rated voltage (W)	
e)	2-Over current trip with 1- earth fault furnished as specified.	
4.38	Breaker/Accessories such as control switch indication lamps etc. furnished as specified: (Please attach separate sheet giving details of all accessories, inter locks and safety shutters)	
a)	Mechanical Safety Interlock	
b)	Automatic Safety Interlock	
c)	Operational Interlock	
d)	Emergency manual trip	
e)	Operation counter	
f)	Charge/discharge indicator	
g)	Manual spring charging facility	
4.39	Impact load foundation design (to include dead load plus impact value on opening at maximum interrupting rating) (Kg)	
5	Isolators	
5.1	Make	
5.2	Type	
5.3	Reference Standard	
5.4	Rated Voltage (KV)	
5.5	Rated Frequency Hz	
5.6	No. of Poles (No)	
5.7	Rated Current Normal (Standard) De-rated (Site) Amp	
5.8	Maximum temperature rise over ambient °C	
5.9	Rated Operation duty	
5.10	Rupturing Capacity at rated voltage MVA	

SN	Description	Particulars
5.11	Rated making current KA Peak	
5.12	Short time current	
a)	for 1 Sec KA RMS	
b)	for 3 Sec KA RMS	
5.13	Impulse voltage withstand on 1/50 full wave	
b)	1 minute 50 Hz voltage withstand	
5.14	Maximum over voltage factor when switching off	
a)	Loaded feeder cable	
5.15	Minimum SF6 Gas pressure required	
5.16	No. of isolator operation permissible without requiring inspection, replacement of contacts and other main Parts	
	At 100% rated current	
	At 100% rated breaking current	
5.17	Isolator provided with the following	
	Mechanical safety	
	Mechanical ON, OFF , CABLE EARTH indicators	
	Operation counter	
	Manual spring charging facility	
5.18	Impact load for foundation design (To include dead load plus impact values on opening at maximum interrupting rating) Kg	
6	CURRENT TRANSFORMER	
6.1	Make	
6.2	Type & voltage level	
6.3	Reference standard	
6.4	C.T. ratio as specified	
6.5	Rated frequency	
6.6	Short circuit withstand	
l)	Short time current for 3 Sec. KA RMS	

SN	Description	Particulars
ii)	Short time current for 5 Sec. KA RMS	
iii.	Dynamic current kA peak	
6.7	Class of insulation	
6.8	Temperature rise over ambient ° C	
6.9	Basic insulation level	
6.10	For tripping	
	CT Ratio	
	Class of accuracy	
	Rated burden VA	
	Knee point voltage V	
	Excitation current at $V_k/2$ Amps	
	Rated saturating current Amp	
	Over current rating	
	Continuous % over load (%)	
7	CABLE TERMINATIONS	
7.1	Circuit Breaker	
	Type	
	Material	
	Dimensions	
	Size	
	Height of cable box from ground level	
	Arrangement for supplying bus end cable box furnished for extensible ring main unit	
	Arrangement for mounting an extra cable box on each equipment furnished	
7.2	Isolator	
	Type	
	Material	
	Dimensions	

SN	Description	Particulars
	Size	
	Height of cable box from ground level	
8	Name Plate	
8.1	Material	
8.2	Thickness	
8.3	Size for	
	a) Breaker cubicle	
	b) Instruments/devices	
9	Painting	
9.1	Finish of Breaker	
	Inside	
	Outside	
9.2	Finish of Isolator	
	Inside	
	Outside	
10	No. of Accessories Furnished	
a)	Earthing Equipment	
b)	Test Plug	
11	TESTS	
11.1	Reference Standard	
11.2	Routine tests to be performed on switchgear	
11.3	Type Tests quoted	
12	Drawing / Data	
12.1	General arrangement for Panel Board	
12.2	Foundation plan	
12.3	Breaker tripping & material schematic	
12.4	Bill of material	
12.5	Breaker LT Panel Wiring Diagram	

SN	Description	Particulars
TRANSFORMER SECTION		
1	General	
1.1	Make	
1.2	Type	
1.3	Reference Standard	
2	Rating	
2.1	Rated output with cooling (kVA)	
2.2	Type of cooling	
2.3	Rated Voltage (kV)	
a)	H.V.	
b)	L.V.	
2.4	Rated Current (Amps)	
a)	H.V.	
b)	L.V.	
2.5	Guaranteed No Load current @ 100% rated voltage	
a)	H.V.	
b)	L.V.	
2.6	Guaranteed No Load current @ 110% rated voltage	
a)	H.V.	
b)	L.V.	
2.7	No. of phases	
2.8	No. of windings per phase	
2.9	Rated Frequency (Hz)	
2.1	Vector Group reference	
3	Temperature	
3.1	Reference ambient temperature (°C)	
3.2 a)	Temperature rise over reference Ambient	
b)	Winding by resistance (°C)	

SN	Description	Particulars
3.3	Maximum continuous overloading capacity of the transformer without exceeding the specified winding temperature	
4	Tappings	
4.1	Type	
4.2	Capacity	
4.3	Range-Steps x % variation	
4.4.	Taps provided on H.V. windings	
4.5	Details of Tappings	
	Tap Position	
	1	
	2	
	3	
	4	
	5	
4.6	Off load Tap Links	
a)	Operating Voltage (kV)	
b)	Rated Current (Amp)	
c)	Type	
d)	Reference Standard	
e)	Number of Poles	
f)	Defined features provided	
5	Impedance at principal tap rated current and frequency (%)	
5.1	Impedance	
5.2	Reactance	
5.3	Resistance	
5.4.	Zero Sequence impedance	
a)	H.V.	
b)	L.V.	
5.5	Resistance of the winding @ 75 Deg C	

SN	Description	Particulars
a)	H.V.	
b)	L.V.	
6	Guaranteed Losses at principal tap full load and 75 Deg C without any positive tolerance	
6.1	No load losses (kW)	
6.2	Load Losses (kW)	
6.3	Total Losses (kW)	
6.4	No Load loss at maximum permissible voltage and frequency (approx.) kW.	
7	Efficiency	
7.1.	Efficiency at 75 Deg C and unity power factor (%)	
a)	at 110% load	
b)	at 100% load	
c)	at 80% load	
d)	at 60% load	
e)	at 40% load	
f)	at 20% load	
7.2	Efficiency @ 75deg C and 0.8 power factor lag (%)	
a)	at 110% load	
b)	at 100% load	
c)	at 80% load	
d)	at 60% load	
e)	at 40% load	
f)	at 20% load	
	Maximum efficiency (%)	
	Load and power factor at which it occurs	
8	Regulation	
	Regulation at full load @75 Deg C	
a)	at Unity power factor	

SN	Description	Particulars
b)	at 0.8 Power factor lagging	
	Regulation at 110% load @ 75 Deg C	
a)	at Unity power factor	
b)	at 0.8 Power factor lagging	
9	No. load current (Amps)	
	At 100% voltage	
a)	H.V.	
b)	L.V.	
	At 110 % voltage	
a)	H.V.	
b)	L.V.	
10	Maximum flux density (Lines/cm²)	
	At 100% rated voltage	
	At 110% rated voltage	
11	Maximum current density Amps/ cm².	
	H.V. Winding	
	L.V. Winding	
	Withstand time and current as multiple of full load current without injury for (Amps x Sec.)	
	Three phase dead short circuit at terminal with rated voltage maintained on the other side.	
	Single phase short circuit at terminal with rated voltage maintained on other side	
12	Cooling System (if applicable)	
	Type of cooling	
	No. of cooling exhaust fans	
	Capacity of cooling exhaust fan	
13	Core	
	Type/Core/or shell	
	Core Material	

SN	Description	Particulars
	Thickness of lamination (mm)	
	Insulation of lamination (mm)	
	Equivalent cross section area (mm ²)	
14	Coils	
14.1	Type of coils	
a)	H.V.	
b)	L.V.	
14.2	Conductor material	
	Gauge/area of cross section of conductor	
a)	H.V.	
b)	L.V.	
14.3	Insulating material (class F)	
a)	H.V. Turn	
b)	L.V. Turn	
c)	L.V. Core	
d)	H.V – L.V.	
14.4	Insulating material thickness (mm)	
a)	H.V. Turn	
b)	L.V. Turn	
c)	L.V. Core	
d)	H.V – L.V.	
15	Minimum design clearance (mm)	
	H.V. to earth in air	
	L.V. to earth in air	
	Between H.V. & L.V. in air	
	Top Winding and Yoke	
	Bottom winding and yoke	
16	Transformer impulse level (kV)	

SN	Description	Particulars
	H.V. Winding	
	L.V. Winding	
17	Bushing	
	Make	
	Type	
	Reference Standard	
	Voltage Class (kV)	
	Creepage distance factor (mm/kV)	
	Weight (Kg)	
	Free space required for bushing removal (mm)	
18	Terminal connections	
	H.V	
	L.V	
	L.V. Neutral	
19	Accessories	
	Each Transformer furnished with fittings and accessories as per Clause No.5.00.00 (Please attach separate sheet giving details)	
20	Overall dimensions	
	Length (mm)	
	Breadth (mm)	
	Height (mm)	
21	Weight Data Kg)	
	Core and frame (Kg)	
	Core windings etc. (Kg)	
	Total Weight (Kg)	
22	Shipping Data	
	Weight of heaviest package (Kg)	
	Dimensions of the largest package (L x B x H) (mm)	
23	Tests	

SN	Description	Particulars
	Routine tests as per IS:11171/1985	
	Core bolt withstand voltage for 1 minute	
	Type Test quoted:	
	Temperature rise test at ANAN rating	
	Impulse Test (kV peak)	
	(Add Sheets if necessary)	
	Partial Discharge Level:	

13.2 Annexure-II: Guaranteed Technical Particulars (Sample) for RMU

SN	Description	MePDCL Requirement
1.0	SWITCHGEAR ASSEMBLY	
1.1	Make	
1.2	Type	
1.3	Reference Standard	
1.4	Voltage (Normal/Max.) kV	
1.5	Phase (Nos.)	
1.6	Frequency (HZ)	
1.7	Short Circuit Rating for 3 Sec. (KA)	
1.8	Insulation Level	
	a) Impulse withstand (KV peak)	
	b) 1 Minute 50 Hz. Voltage withstand (KV rms)	
1.9	Metal Clad Construction	
1.10	A) Degree of protection for outer enclosure: B) Degree of protection for main tank:	
1.11	Switchgear completely wire and tested at factory (yes/No)	
2.0	CONSTRUCTION	
2.1	Overall Dimensions	
A	Extensible Way RMU	
	i) Width (W) (mm)	
	ii) Depth (D) (mm)	
	iii) Height (mm)	
2.2	Overall Weight of RMU	
3.0	Bus bar	
3.1	Make	
3.2	Material & Grade	
3.3	Reference Standard	
3.4	a) Cross sectional area (mm ²)	

SN	Description	MePDCL Requirement
3.5	Continuous Current	
	a) Standard	
	b) At site conditions and within cubicle	
3.6	Maximum temperature rise over ambient (c)	
3.7	Minimum clearance from bare bus bar Connection	
	a) Phase to phase (mm)	
	b) Phase to Earth (mm)	
3.9	Bus Bar provided with	
	a) Insulation Sleeve	
	b) Phase barriers	
	c) Cast Resin shrouds for joints	
3.10	Bus bar connection	
	a) Silver Plated	
	b) Made with anti-oxide grease	
3.11	Bus Bar support spacing (mm)	
3.12	Bus support insulators	
	a) Make	
	b) Type	
	c) Reference Standard	
	d) Voltage Class (KV)	
	e) Minimum creep age distance (mm)	
	f) Cantilever strength Kg/mm ²	
	g) Net Weight (Kg)	
3.13	SF6 gas pressure (filling pressure at 20 deg. C)	
4.0	SF6/VCB CIRCUIT BREAKER	
4.1	Make	
4.2	Type (Vacuum/ SF6)	
4.3	Reference Standard	

SN	Description	MePDCL Requirement
4.4	Rated Voltage	
4.5	Rated Frequency	
4.6	No. of Poles	
4.7	Rated Current	
	a) Normal (Standard) Amps	
	b) Rated (Site) Amps	
4.8	Maximum temperatures rise over ambient. (deg. C)	
4.9	Rated operating Duty	
4.11	Breaking Capacity at rated voltage & operating duty	
4.12	Rated making current (KA peak)	
	b) Short time current for 3 Sec. (KA rms)	
4.13	Transient Recovery Voltage	
	a) Rate of rise (KV/ms)	
	b) Peak Voltage (KV)	
4.14	Insulation Level	
	a) Impulse Voltage with stand on 1/50 full wave	
	b) 1-minute 50Hz voltage withstand	
4.15	Opening time Maximum, No load condition (ms)	
4.16	Opening and closing time under SF6 gas loss or vacuum loss condition (ms)	
4.17	At 100% Breaking capacity	
	a) Opening time – max (ms)	
	b) Arcing time – max (ms)	
	c) Total break time (ms)	
4.18	At 60% Breaking capacity	
	a) Opening time – max (ms)	
	b) Arcing time – max (ms)	
	c) Total break time (ms)	

SN	Description	MePDCL Requirement
4.19	At 30% Breaking capacity	
	a) Opening time – max (ms)	
	b) Arcing time – max (ms)	
	c) Total break time (ms)	
4.20	At 10% Breaking capacity	
	a) Opening time – max (ms)	
	b) Arcing time – max (ms)	
	c) Total break time (ms)	
4.21	Number of breaks per pole	
4.22	No of breaker operations permissible without requiring inspection replacement of contacts and other main parts.	
	a) At 100% rated current	
4.23	Type of contacts	
	a) Main	
	b) Arcing	
4.24	Material of contacts	
	a) Main	
	b) Arching	
	c) Whether contacts silver plated	
	d) Thickness of silver plating	
4.25	Operating mechanism- closing	
	a) Type	
	b) No of breaker operations stored	
	C) Trip free or fixed trip	
	d) Anti pumping features provided	
	e) Earthing for operating mechanism and metal parts furnished	
	f) Earth terminal size and material	
4.26	Operating mechanism- tripping	

SN	Description	MePDCL Requirement
	a) Type	
	b) No of breaker operations stored	
	c) Trip free or fixed trip (V)	
	d) Anti pumping features provided (%)	
	e) Earthing for operating mechanism and metal parts furnished	
	f) Earth terminal size and material	
4.27	Spring charging mechanism	
	2) Make	
	3) Type	
	4) Size	
	5) Rating	
4.29	Breaker suitable for capacity switching 4 operating duty 5Max.rating of capacitor bank that can be safely controlled	
4.30	Tripping coil	
	a) Voltage	
	b) Permissible voltage variation (%)	
	c) Tripping current at rated voltage (A)	
	d) Power at rated voltage (W)	
	e) 2-Over current trip with TLF (5A) and 1-earth fault furnished as specified	
4.31	Breaker /Accessories such as control switch indication Lamps etc. furnished as specified : (please attach separate sheet giving details of all accessories, inter locks and safety shutters)	
	a) Mechanical safety Interlock	
	b) Automatic Safety Interlock	
	C) Operational Interlock	
	d) Emergency manual trip	
	e) Operation counter	
	f) Charge /discharge indicator	

SN	Description	MePDCL Requirement
	g) Manual spring charging facility	
4.32	Impact load foundation design (to include dead load plus impact value on opening at maximum interrupting rating) (KG)	
5.0	Isolators/Load Break Switch	
5.1	Make	
5.2	Type	
5.3	Reference standard	
5.4	Rated voltage (KV)	
5.5	Rated Frequency HZ	
5.6	No. Of poles (No)	
5.7	Rated current	
	a) Normal (Standard) Amps	
	b) De-rated (site) Amp	
5.8	Maximum temperature rise over ambient Deg. C	
5.9	Rated operation duty	
5.10	Rupturing Capacity at rated voltage MVA	
5.11	Rated making current KA peak	
5.12	Short time current	
	b) For 3 sec KA rms	
5.13	Impulse voltage withstands on 1/50 full wave	
5.14	Maximum over voltage factor when switching off a) Loaded feeder cable	
5.15	Operating SF6 Gas pressure	
5.16	No of isolator operation permissible without requiring inspection, replacement of contacts and other main parts	
	At 100% rated current At 100% rated breaking current	
	Isolator provided with the following; Mechanical safety Mechanical ON, OFF, CABLE EARTH indicators Operation counter Manual spring charging facility	

SN	Description	MePDCL Requirement
5.17		
5.18	Impact load for foundation design (To include dead load plus impact Values on opening at maximum interrupting rating) Kg	
6.0	CURRENT TRANSFORMER	
6.1	Make	
6.2	Type & voltage level	
6.3	Reference standard	
6.4	C.T. ratio as specified	
6.5	Rated frequency	
6.7	Class of insulation	
6.8	Temperature rises over ambient. Deg. C	
6.9	Basic insulation level	
6.10	For tripping CT RATIO Class of accuracy	
	Rated Burden VA	
	Knee Point Voltage V	
	Excitation Current at $V_k/2$ Amps	
	Rated Saturating Current Amps	
	Over Current Rating	
	Continuous % Over Load %	
7.0	Cable terminations	
7.1	Circuit Breaker	
	Type	
	Materials	
	Dimensions	
	Size	
	Height of Cable box from ground Level	
	Arrangement for supplying bus end cable box furnished for extensible ring main Unit	

SN	Description	MePDCL Requirement
	Arrangement for mounting an extra cable box on each equipment furnished	
7.2	Isolator	
	Type	
	Materials	
	Dimensions	
	Size	
	Height of Cable box from ground Level	
	Arrangement for supplying bus end cable box furnished for extensible ring main Unit	
	Arrangement for mounting an extra cable box on each equipment furnished	
8.0	Name Plate	
8.1	Material	
8.2	Thickness	
8.3	Size for Breaker Cubicle Instruments / Devices	
9.0	Painting	
9.1	Finish of Breaker	
	Inside	
	Outside	
9.2	Finish of Isolator	
	Inside	
	Outside	
10.0	Drawing / Data	
10.1	General arrangement for Panel Board	
10.2	Foundation plan	
10.3	SF6/VCB tripping and material Schematic	
10.4	Bill of Material	
10.5	SF6/VCB LT panel wiring diagram	

13.3 Annexure-III: Guaranteed Technical Particulars (Sample) for Feeder Pillars

Guaranteed Technical Particulars (GTP) Feeder Pillar		
SN	Description	Details
A	General	
1	Name of Manufacturer	
2	Product Designation	
3	Product Details	
4	Configuration	
5	Incoming Circuit	
6	Outgoing Circuit	
7	Application of product	
8	Humidity	
B	System Information	
1	Rated Voltage	
2	No. of phases	
3	Frequency	
C	Pillar Construction	
9	Painting	
10	Color	
11	Degree of protection	
12	Panel Dimensions (H x W x D)	

TECHNICAL SPECIFICATIONS FOR “EXTERNAL FIRE SYSTEM”

14 General

14.1 Applicable Codes/ Standards/ Guidelines

The following Codes/ Standards/ Guidelines will be applicable (in order of applicability, i.e. if specification of an item/ work is not available in a particular Code/ Standard/ Guideline, then the immediate next one will be applicable):

- 13039: 1991 – External Hydrant Systems – Provisions and Maintenance Code of Practice
- 3844: 1989 – Code of practice for installation and maintenance of internal fire hydrants and hose reels on premises
- 1641:1988 – Code of practice for fire safety of buildings (general): General principles of fire grading and classification
- 2171:1999 – Specification for portable fire extinguishers, dry powder (cartridge type)
- 2546:1974 – Specification for galvanized mild steel fire buckets
- 2878:2004 – Fire extinguisher, carbon dioxide type (portable and trolley mounted) – specification
- 4308:2003 – Dry chemical powder for fighting B and C class fires - specification
- 7673:2004 – Firefighting equipment
- 10204:2001 – Specification for portable fire extinguisher, mechanical foam type
- 14609:1999 – Dry chemical powder fighting A, B, C class fires – specification
- IS 2190:2010 – Selection, installation, and maintenance of first aid fire extinguishers – code of practice
- IS 15683: 2006 – Portable fire extinguishers – performance and construction

